

Building services

For details on the standard values listed below, system-specific guidance, and additional regulatory requirements, refer to the Approved Documents.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	YES
Whole building electric power factor achieved by power factor correction	>0.95

1- Corridors Heaters

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	1	-	0.2	-	-
Standard value	N/A	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

"No HWS in project, or hot water is provided by HVAC system"

"No zones in project where local mechanical ventilation, exhaust, or terminal unit is applicable"

General lighting and display lighting		General luminaire		Display light source	
Zone name	Efficacy [lm/W]	Efficacy [lm/W]	Power density [W/m²]		
Standard value	95	80	0.3		
M-02-Circulation	120	-	-		
M-02-Lift Lobby	120	-	-		
M-00-Concierge Lobby	120	-	-		
M-00-Corridor	120	-	-		
M-00-Sterile Lobby	120	-	-		
M-00-Corridor	120	-	-		
M-03-Lift Lobby	120	-	-		
M-03-Circulation	120	-	-		
M-04-Lift Lobby	120	-	-		
M-04-Circulation	120	-	-		
M-05-Lift Lobby	120	-	-		
M-05-Circulation	120	-	-		
M-06-Lift Lobby	120	-	-		
M-06-Circulation	120	-	-		
M-07-Lift Lobby	120	-	-		
M-07-Circulation	120	-	-		
M-08-Lift Lobby	120	-	-		
M-08-Circulation	120	-	-		
M-09-Lift Lobby	120	-	-		
M-09-Circulation	120	-	-		
M-10-Lift Lobby	120	-	-		
M-10-Circulation	120	-	-		
M-11-Lift Lobby	120	-	-		
M-11-Circulation	120	-	-		
M-12-Lift Lobby	120	-	-		
M-12-Circulation	120	-	-		
M-13-Lift Lobby	120	-	-		
M-13-Circulation	120	-	-		
M-14-Lift Lobby	120	-	-		

General lighting and display lighting		General luminaire		Display light source	
Zone name	Efficacy [lm/W]	Efficacy [lm/W]	Power density [W/m²]		
Standard value	95	80	0.3		
M-14-Circulation	120	-	-		
M-15-Lift Lobby	120	-	-		
M-15-Circulation	120	-	-		
M-16-Lift Lobby	120	-	-		
M-16-Circulation	120	-	-		
M-17-Lift Lobby	120	-	-		
M-17-Circulation	120	-	-		
M-18-Lift Lobby	120	-	-		
M-18-Circulation	120	-	-		
M-19-Corridor-01	120	-	-		
M-19-Corridor-01	120	-	-		
M-20-Corridor-01	120	-	-		
M-20-Corridor-01	120	-	-		
M-00-Circulation	120	-	-		

The spaces in the building should have appropriate passive control measures to limit the effects of solar gains in summer

There are no zones in the building where the solar gain check is applicable.

Regulation 25A: Consideration of high efficiency alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)			
Building Global Parameters			Building Use
	Actual	Notional	% Area Building Type
Floor area [m²]	2207.5	2207.5	Retail/Financial and Professional Services
External area [m²]	362.3	362.3	Restaurants and Cafes/Drinking Establishments/Takeaways
Weather	LON	LON	Offices and Workshop Businesses
Infiltration [m³/hm²@ 50Pa]	3	3	General Industrial and Special Industrial Groups
Average conductance [W/K]	42.25	85.49	Storage or Distribution
Average U-value [W/m²K]	0.12	0.24	Hotels
Alpha value* [%]	25	10	Residential Institutions: Hospitals and Care Homes
* Percentage of the building's average heat transfer coefficient which is due to thermal bridging			Residential Institutions: Residential Schools
			Residential Institutions: Universities and Colleges
			Secure Residential Institutions
			100 Residential Spaces
			Non-residential Institutions: Community/Day Centre
			Non-residential Institutions: Libraries, Museums, and Galleries
			Non-residential Institutions: Education
			Non-residential Institutions: Primary Health Care Building
			Non-residential Institutions: Crown and County Courts
			General Assembly and Leisure, Night Clubs, and Theatres
			Others: Passenger Terminals
			Others: Emergency Services
			Others: Miscellaneous 24hr Activities
			Others: Car Parks 24 hrs
			Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m²]		
	Actual	Notional
Heating	0.05	0.12
Cooling	0	0
Auxiliary	0	0
Lighting	5.73	7.4
Hot water	0	0
Equipment*	13.13	13.13
TOTAL**	5.78	7.51
* Energy used by equipment does not count towards the total for consumption or calculating emissions.		
** Total is net of any electrical energy displaced by CHP generators, if applicable.		

Energy Production by Technology [kWh/m²]		
	Actual	Notional
Photovoltaic systems	2.1	1.57
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	2.1	1.57

Energy & CO ₂ Emissions Summary		
	Actual	Notional
Heating + cooling demand [MJ/m²]	0.16	0.59
Primary energy [kWh _{PE} /m²]	5.43	8.78
Total emissions [kg/m²]	0.51	0.82

HVAC Systems Performance									
System Type	Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEEf	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Other local room heater - unfanned, [HS] Direct or storage electric heater, [HFT] Electricity, [CFT] Electricity									
Actual	0.2	0	0.1	0	0	0.84	0	1	0
Notional	0.6	0	0.1	0	0	1.41	0	----	----

Key to terms	
Heat dem [MJ/m2]	= Heating energy demand
Cool dem [MJ/m2]	= Cooling energy demand
Heat con [kWh/m2]	= Heating energy consumption
Cool con [kWh/m2]	= Cooling energy consumption
Aux con [kWh/m2]	= Auxiliary energy consumption
Heat SSEEf	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEEf	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

12.70 Block N

BRUKL Output Document

HM Government

Compliance with England Building Regulations Part L 2021

Project name	
Aylesham Centre_Block N Communal Be Green	As designed
Date: Mon Mar 17 12:45:55 2025	

Administrative information	
Building Details	Certification tool
Address: Address 1, City, Postcode	Calculation engine: Apache
	Calculation engine version: 7.0.27
	Interface to calculation engine: IES Virtual Environment
	Interface to calculation engine version: 7.0.27
	BRUKL compliance module version: v6.1.e.1
Certifier details	
Name: ME Engineers	
Telephone number: Phone	
Address: Street Address, City, Postcode	
	Foundation area [m²]: 61.35

The CO₂ emission and primary energy rates of the building must not exceed the targets

Target CO ₂ emission rate (TER), kgCO ₂ /m²annum	1.75
Building CO ₂ emission rate (BER), kgCO ₂ /m²annum	1.06
Target primary energy rate (TPER), kWh _e /m²annum	17.85
Building primary energy rate (BPER), kWh _e /m²annum	10.26
Do the building's emission and primary energy rates exceed the targets?	BER =< TER BPER =< TPER

The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Fabric element	U _a -Limit	U _a -Calc	U _i -Calc	First surface with maximum value
Walls*	0.26	0.15	0.15	N0000054:Surf[1]
Floors	0.18	0.11	0.11	N0000054:Surf[0]
Pitched roofs	0.16	-	-	No pitched roofs in building
Flat roofs	0.18	0.11	0.11	N0000113:Surf[1]
Windows** and roof windows	1.6	1.31	1.31	N0000083:Surf[0]
Rooflights***	2.2	-	-	No roof lights in building
Personnel doors^	1.6	-	-	No personnel doors in building
Vehicle access & similar large doors	1.3	-	-	No vehicle access doors in building
High usage entrance doors	3	-	-	No high usage entrance doors in building
U _a -Limit = Limiting area-weighted average U-values [W/(m²K)] U _a -Calc = Calculated area-weighted average U-values [W/(m²K)] U _i -Calc = Calculated maximum individual element U-values [W/(m²K)] * Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows. ** Display windows and similar glazing are excluded from the U-value check. *** Values for rooflights refer to the horizontal position. ^ For fire doors, limiting U-value is 1.8 W/m²K NB: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				
Air permeability	Limiting standard	This building		
m³/(h.m²) at 50 Pa	8	3		

Building services

For details on the standard values listed below, system-specific guidance, and additional regulatory requirements, refer to the Approved Documents.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	YES
Whole building electric power factor achieved by power factor correction	>0.95

1- Corridors Heaters

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	1	-	0.2	-	-
Standard value	N/A	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

"No HWS in project, or hot water is provided by HVAC system"

"No zones in project where local mechanical ventilation, exhaust, or terminal unit is applicable"

General lighting and display lighting	General luminaire		Display light source	
	Efficacy [lm/W]	Efficacy [lm/W]	Power density [W/m²]	
Zone name				
Standard value	95	80	0.3	
N-00-Lobby	120	-	-	
N-00-Corridor	120	-	-	
N-01-Corridor	120	-	-	
N-01-Circulation	120	-	-	
N-00-Corridor-01	120	-	-	
N-00-Corridor-01	120	-	-	
N-00-Corridor-01	120	-	-	
N-00-Corridor-01	120	-	-	
N-00-Corridor-01	120	-	-	
N-07-Corridor-01	120	-	-	
N-07-Corridor-01	120	-	-	
N-08-Corridor-01	120	-	-	
N-08-Corridor-01	120	-	-	
N-09-Corridor-01	120	-	-	
N-09-Corridor-01	120	-	-	
N-10-Corridor-01	120	-	-	
N-10-Corridor-01	120	-	-	
N-11-Corridor-01	120	-	-	
N-11-Corridor-01	120	-	-	
N-12-Corridor-01	120	-	-	
N-12-Corridor-01	120	-	-	
N-00-Corridor	120	-	-	
N-00-Corridor	120	-	-	
N-00-Corridor	120	-	-	

The spaces in the building should have appropriate passive control measures to limit the effects of solar gains in summer

There are no zones in the building where the solar gain check is applicable.

Regulation 25A: Consideration of high efficiency alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters			Building Use	
	Actual	Notional	% Area	Building Type
Floor area [m²]	797.5	797.5		Retail/Financial and Professional Services
External area [m²]	608.7	608.7		Restaurants and Cafes/Drinking Establishments/Takeaways
Weather	LON	LON		Offices and Workshop Businesses
Infiltration [m³/hm² @ 50Pa]	3	3		General Industrial and Special Industrial Groups
Average conductance [W/K]	162.18	310.41		Storage or Distribution
Average U-value [W/m²K]	0.27	0.51		Hotels
Alpha value* [%]	25	10		Residential Institutions: Hospitals and Care Homes
* Percentage of the building's average heat transfer coefficient which is due to thermal bridging				Residential Institutions: Residential Schools
				Residential Institutions: Universities and Colleges
				Secure Residential Institutions
			100	Residential Spaces
				Non-residential Institutions: Community/Day Centre
				Non-residential Institutions: Libraries, Museums, and Galleries
				Non-residential Institutions: Education
				Non-residential Institutions: Primary Health Care Building
				Non-residential Institutions: Crown and County Courts
				General Assembly and Leisure, Night Clubs, and Theatres
				Others: Passenger Terminals
				Others: Emergency Services
				Others: Miscellaneous 24hr Activities
				Others: Car Parks 24 hrs
				Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m²]

	Actual	Notional
Heating	6.7	7.03
Cooling	0	0
Auxiliary	0	0
Lighting	4.55	7.23
Hot water	0	0
Equipment*	13.13	13.13
TOTAL**	11.25	14.27

* Energy used by equipment does not count towards the total for consumption or calculating emissions.
** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m²]

	Actual	Notional
Photovoltaic systems	4.65	2.53
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	4.65	2.53

Energy & CO₂ Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m²]	20.31	35.72
Primary energy [kWh _{PE} /m²]	10.26	17.85
Total emissions [kg/m²]	1.06	1.75

HVAC Systems Performance									
System Type	Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEFF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Other local room heater - unfanned, [HS] Direct or storage electric heater, [HFT] Electricity, [CFT] Electricity									
Actual	20.3	0	6.7	0	0	0.84	0	1	0
Notional	35.7	0	7	0	0	1.41	0	----	----

Key to terms	
Heat dem [MJ/m2]	= Heating energy demand
Cool dem [MJ/m2]	= Cooling energy demand
Heat con [kWh/m2]	= Heating energy consumption
Cool con [kWh/m2]	= Cooling energy consumption
Aux con [kWh/m2]	= Auxiliary energy consumption
Heat SSEFF	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEFF	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

12.71 Block P

BRUKL Output Document

 HM Government

Compliance with England Building Regulations Part L 2021

Project name

Aylesham Centre_Block P Communal_Be Green

As designed

Date: Sun Dec 01 18:04:35 2024

Administrative information

Building Details

Address: Address 1, City, Postcode

Certification tool

Calculation engine: Apache

Calculation engine version: 7.0.26

Interface to calculation engine: IES Virtual Environment

Interface to calculation engine version: 7.0.26

BRUKL compliance module version: v6.1.e.1

Certifier details

Name: ME Engineers

Telephone number: Phone

Address: Street Address, City, Postcode

Foundation area [m²]: 74.27

The CO ₂ emission and primary energy rates of the building must not exceed the targets		
Target CO ₂ emission rate (TER), kgCO ₂ /m²annum	1.07	
Building CO ₂ emission rate (BER), kgCO ₂ /m²annum	0.66	
Target primary energy rate (TPER), kWh _{pe} /m²annum	11.12	
Building primary energy rate (BPER), kWh _{pe} /m²annum	6.64	
Do the building's emission and primary energy rates exceed the targets?	BER =< TER	BPER =< TPER

The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Fabric element	U _a -Limit	U _a -Calc	U _i -Calc	First surface with maximum value
Walls*	0.26	0.15	0.15	P000007C:Surf[1]
Floors	0.18	0.11	0.11	P000007C:Surf[0]
Pitched roofs	0.16	-	-	No pitched roofs in building
Flat roofs	0.18	0.11	0.11	P000019F:Surf[0]
Windows** and roof windows	1.6	1.3	1.3	P00001A5:Surf[1]
Rooflights***	2.2	-	-	No roof lights in building
Personnel doors^	1.6	-	-	No personnel doors in building
Vehicle access & similar large doors	1.3	-	-	No vehicle access doors in building
High usage entrance doors	3	-	-	No high usage entrance doors in building
U _a -Limit = Limiting area-weighted average U-values [W/(m²K)] U _a -Calc = Calculated area-weighted average U-values [W/(m²K)] U _i -Calc = Calculated maximum individual element U-values [W/(m²K)] * Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows. ** Display windows and similar glazing are excluded from the U-value check. *** Values for rooflights refer to the horizontal position. ^ For fire doors, limiting U-value is 1.8 W/m²K NB: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				
Air permeability	Limiting standard	This building		
m³/(h.m²) at 50 Pa	8	3		

Building services

For details on the standard values listed below, system-specific guidance, and additional regulatory requirements, refer to the Approved Documents.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	YES
Whole building electric power factor achieved by power factor correction	>0.95

1- Corridors Heaters

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	1	-	0.2	-	-
Standard value	N/A	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

"No HWS in project, or hot water is provided by HVAC system"

"No zones in project where local mechanical ventilation, exhaust, or terminal unit is applicable"

General lighting and display lighting		General luminaire		Display light source	
Zone name		Efficacy [lm/W]	Efficacy [lm/W]	Power density [W/m²]	
	Standard value	95	80	0.3	
P-02-Circulaion	120	-	-	-	
P-00-Lobby	120	-	-	-	
P-00-Circulation	120	-	-	-	
P-00-Circulation	120	-	-	-	
P-01-Corridor	120	-	-	-	
P-03-Circulation	120	-	-	-	
P-04-Circulation	120	-	-	-	
P-05-Circulation	120	-	-	-	
P-06-Circulation	120	-	-	-	
P-07-Circulation	120	-	-	-	
P-08-Circulation	120	-	-	-	
P-09-Circulation	120	-	-	-	
P-10-Circulation	120	-	-	-	
P-11-Circulation	120	-	-	-	
P-11-Circulation	120	-	-	-	
P-11-Circulation	120	-	-	-	
P-10-Circulation	120	-	-	-	
P-10-Circulation	120	-	-	-	
P-09-Circulation	120	-	-	-	
P-09-Circulation	120	-	-	-	
P-08-Circulation	120	-	-	-	
P-07-Circulation	120	-	-	-	
P-07-Circulation	120	-	-	-	
P-06-Circulation	120	-	-	-	
P-06-Circulation	120	-	-	-	
P-05-Circulation	120	-	-	-	
P-04-Circulation	120	-	-	-	
P-04-Circulation	120	-	-	-	
P-03-Circulation	120	-	-	-	

General lighting and display lighting		General luminaire		Display light source	
Zone name		Efficacy [lm/W]	Efficacy [lm/W]	Power density [W/m²]	
	Standard value	95	80	0.3	
P-03-Circulation	120	-	-	-	
P-02-Circulation	120	-	-	-	
P-02-Circulation	120	-	-	-	
P-05-Circulation	120	-	-	-	
P-01-Corridor	120	-	-	-	

The spaces in the building should have appropriate passive control measures to limit the effects of solar gains in summer

There are no zones in the building where the solar gain check is applicable.

Regulation 25A: Consideration of high efficiency alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Floor area [m²]	891.2	891.2
External area [m²]	441.7	441.7
Weather	LON	LON
Infiltration [m³/hm²@ 50Pa]	3	3
Average conductance [W/K]	99.76	201.96
Average U-value [W/m²K]	0.23	0.46
Alpha value* [%]	25	10

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area	Building Type
	Retail/Financial and Professional Services
	Restaurants and Cafes/Drinking Establishments/Takeaways
	Offices and Workshop Businesses
	General Industrial and Special Industrial Groups
	Storage or Distribution
	Hotels
	Residential Institutions: Hospitals and Care Homes
	Residential Institutions: Residential Schools
	Residential Institutions: Universities and Colleges
	Secure Residential Institutions
100	Residential Spaces
	Non-residential Institutions: Community/Day Centre
	Non-residential Institutions: Libraries, Museums, and Galleries
	Non-residential Institutions: Education
	Non-residential Institutions: Primary Health Care Building
	Non-residential Institutions: Crown and County Courts
	General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger Terminals
	Others: Emergency Services
	Others: Miscellaneous 24hr Activities
	Others: Car Parks 24 hrs
	Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m²]		
	Actual	Notional
Heating	2.09	2.71
Cooling	0	0
Auxiliary	0	0
Lighting	5.62	7.41
Hot water	0	0
Equipment*	13.13	13.13
TOTAL**	7.71	10.13
* Energy used by equipment does not count towards the total for consumption or calculating emissions.		
** Total is net of any electrical energy displaced by CHP generators, if applicable.		

Energy Production by Technology [kWh/m²]		
	Actual	Notional
Photovoltaic systems	3.33	2.74
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	3.33	2.74

Energy & CO ₂ Emissions Summary		
	Actual	Notional
Heating + cooling demand [MJ/m²]	6.34	13.78
Primary energy [kWh _{PE} /m²]	6.64	11.12
Total emissions [kg/m²]	0.66	1.07

12.72 Block Q

BRUKL Output Document		HM Government
Compliance with England Building Regulations Part L 2021		
Project name		
Aylesham Centre_Block Q_Be Green PV12		As designed
Date: Sat Nov 30 19:00:24 2024		
Administrative information		
Building Details		Certification tool
Address: Address 1, City, Postcode		Calculation engine: Apache
		Calculation engine version: 7.0.26
		Interface to calculation engine: IES Virtual Environment
		Interface to calculation engine version: 7.0.26
		BRUKL compliance module version: v6.1.e.1
Certifier details		
Name: ME Engineers		
Telephone number: Phone		
Address: Street Address, City, Postcode		
		Foundation area [m²]: 72.56

The CO ₂ emission and primary energy rates of the building must not exceed the targets		
Target CO ₂ emission rate (TER), kgCO ₂ /m²annum	1.05	
Building CO ₂ emission rate (BER), kgCO ₂ /m²annum	0.63	
Target primary energy rate (TPER), kWh _{PE} /m²annum	10.35	
Building primary energy rate (BPER), kWh _{PE} /m²annum	5.96	
Do the building's emission and primary energy rates exceed the targets?	BER =< TER	BPER =< TPER

The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency				
Fabric element	U _a -Limit	U _a -Calc	U _i -Calc	First surface with maximum value
Walls*	0.26	0.15	0.15	Q0000003:Surf[0]
Floors	0.18	0.11	0.11	P0000071:Surf[0]
Pitched roofs	0.16	-	-	No pitched roofs in building
Flat roofs	0.18	0.11	0.11	Q00000B4:Surf[0]
Windows** and roof windows	1.6	1.3	1.3	Q00000BD:Surf[0]
Rooflights***	2.2	-	-	No roof lights in building
Personnel doors^	1.6	-	-	No personnel doors in building
Vehicle access & similar large doors	1.3	-	-	No vehicle access doors in building
High usage entrance doors	3	-	-	No high usage entrance doors in building
U _a -Limit = Limiting area-weighted average U-values [W/(m²K)] U _a -Calc = Calculated area-weighted average U-values [W/(m²K)] U _i -Calc = Calculated maximum individual element U-values [W/(m²K)] * Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows. ** Display windows and similar glazing are excluded from the U-value check. *** Values for rooflights refer to the horizontal position. ^ For fire doors, limiting U-value is 1.8 W/m²K NB: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				
Air permeability	Limiting standard	This building		
m³/(h.m²) at 50 Pa	8	3		

Technical Data Sheet (Actual vs. Notional Building)			
Building Global Parameters			Building Use
	Actual	Notional	% Area Building Type
Floor area [m²]	435.3	435.3	Retail/Financial and Professional Services
External area [m²]	343.5	343.5	Restaurants and Cafes/Drinking Establishments/Takeaways
Weather	LON	LON	Offices and Workshop Businesses
Infiltration [m³/hm²@ 50Pa]	3	3	General Industrial and Special Industrial Groups
Average conductance [W/K]	72.32	139.99	Storage or Distribution
Average U-value [W/m²K]	0.21	0.41	Hotels
Alpha value* [%]	25	10	Residential Institutions: Hospitals and Care Homes
* Percentage of the building's average heat transfer coefficient which is due to thermal bridging			Residential Institutions: Residential Schools
			Residential Institutions: Universities and Colleges
			Secure Residential Institutions
			100 Residential Spaces
			Non-residential Institutions: Community/Day Centre
			Non-residential Institutions: Libraries, Museums, and Galleries
			Non-residential Institutions: Education
			Non-residential Institutions: Primary Health Care Building
			Non-residential Institutions: Crown and County Courts
			General Assembly and Leisure, Night Clubs, and Theatres
			Others: Passenger Terminals
			Others: Emergency Services
			Others: Miscellaneous 24hr Activities
			Others: Car Parks 24 hrs
			Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m²]		
	Actual	Notional
Heating	3.64	4.69
Cooling	0	0
Auxiliary	0	0
Lighting	5.75	7.56
Hot water	0	0
Equipment*	13.13	13.13
TOTAL**	9.38	12.25

* Energy used by equipment does not count towards the total for consumption or calculating emissions.
** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m²]		
	Actual	Notional
Photovoltaic systems	5.53	5.48
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	5.53	5.48

Energy & CO ₂ Emissions Summary		
	Actual	Notional
Heating + cooling demand [MJ/m²]	13.1	23.8
Primary energy [kWh _{PE} /m²]	5.96	10.35
Total emissions [kg/m²]	0.63	1.05

HVAC Systems Performance									
System Type	Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEE	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Other local room heater - unfanned, [HS] Direct or storage electric heater, [HFT] Electricity, [CFT] Electricity									
Actual	13.1	0	3.6	0	0	1	0	1	0
Notional	23.8	0	4.7	0	0	1.41	0	----	----

Key to terms	
Heat dem [MJ/m2]	= Heating energy demand
Cool dem [MJ/m2]	= Cooling energy demand
Heat con [kWh/m2]	= Heating energy consumption
Cool con [kWh/m2]	= Cooling energy consumption
Aux con [kWh/m2]	= Auxiliary energy consumption
Heat SSEE	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEE	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

PPENDIX G Overheating Assessment Result

12.73 Current Weather File-DSY 1

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range > 26.00	Status
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	0.8	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range > 26.00	Status
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	0.9	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.0	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	0.8	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	0.9	Pass
L11 D3 LR	Living Room/Kitchen	1.3	Pass
L11 D4 LR	Living Room/Kitchen	1.8	Pass
L11 D2 LR	Living Room/Kitchen	1.6	Pass
L12 D3 LR	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.9	Pass
LR	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.8	Pass
L12 D3 LR	Living Room/Kitchen	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LR	Living Room/Kitchen	1.5	Pass
LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.6	Pass
L12 D3 LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.7	Pass
L12 D3 LR	Living Room/Kitchen	1.1	Pass
LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	1.3	Pass
L12 D3 LR	Living Room/Kitchen	1.4	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.3	Pass
L12 D3 LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.0	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.0	Pass
L12 D3 LR	Living Room/Kitchen	1.4	Pass
LR	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	2.0	Pass
L12 D3 LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	0.8	Pass
LR	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	0.9	Pass
Living Room	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.1	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.0	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	0.8	Pass
LKD	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	0.9	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.1	Pass
LKD	Living Room/Kitchen	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.0	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.4	Pass
LR	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
L11 D1 B2	Bedroom	2.6	Pass
L11 D2 B1	Bedroom	2.0	Pass
L11 D3 B1	Bedroom	2.2	Pass
L11 D4 B1	Bedroom	1.9	Pass
L11 D4 B2	Bedroom	2.0	Pass
L11 D5 LR / B1	Living Room/Kitchen	2.0	Pass
L11 D6 B3	Bedroom	2.1	Pass
L12 D2 B2	Bedroom	1.8	Pass
L12 D3 B1	Bedroom	1.8	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.6	Pass
L12 D6 B1	Bedroom	1.5	Pass
L12 D2 B1	Bedroom	1.6	Pass
L12 D2 B2	Bedroom	1.6	Pass
L12 D2 B1	Bedroom	2.1	Pass
L12 D1 B2	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
L12 D4 B1	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
L12 D2 B2	Bedroom	1.9	Pass
L12 D3 B1	Bedroom	1.9	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.7	Pass
L12 D6 B1	Bedroom	1.7	Pass
L12 D2 B1	Bedroom	1.6	Pass
L12 D1 B2	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
L12 D4 B1	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
L12 D2 B2	Bedroom	2.6	Pass
L12 D3 B1	Bedroom	2.0	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.2	Pass
L12 D6 B1	Bedroom	1.9	Pass
L12 D2 B1	Bedroom	2.0	Pass
L12 D1 B2	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
L12 D4 B1	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
L12 D2 B2	Bedroom	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D3 B1	Bedroom	1.6	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.1	Pass
L12 D6 B1	Bedroom	1.7	Pass
L12 D2 B1	Bedroom	2.1	Pass
L12 D1 B2	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
L12 D4 B1	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
L12 D2 B2	Bedroom	1.9	Pass
L12 D3 B1	Bedroom	1.9	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.3	Pass
L12 D6 B1	Bedroom	1.7	Pass
L12 D2 B1	Bedroom	1.0	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
L12 D4 B1	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
L12 D2 B2	Bedroom	2.3	Pass
L12 D3 B1	Bedroom	1.7	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.9	Pass
L12 D6 B1	Bedroom	0.8	Pass
L12 D2 B1	Bedroom	1.3	Pass
L12 D1 B2	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
L12 D4 B1	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
L12 D2 B2	Bedroom	0.9	Pass
L12 D3 B1	Bedroom	1.3	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.8	Pass
L12 D6 B1	Bedroom	1.6	Pass
L12 D2 B1	Bedroom	1.6	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
L12 D4 B1	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D2 B2	Bedroom	2.9	Pass
L12 D3 B1	Bedroom	2.4	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.4	Pass
L12 D6 B1	Bedroom	2.7	Pass
L12 D2 B1	Bedroom	2.0	Pass
L12 D1 B2	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
L12 D4 B1	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
L12 D6 B1	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
L12 D2 B2	Bedroom	1.6	Pass
L12 D2 B1	Bedroom	2.1	Pass
L12 D1 B2	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
L12 D6 B1	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom LKD	Living Room/Kitchen	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom LKD	Living Room/Kitchen	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom LKD	Living Room/Kitchen	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom LKD	Living Room/Kitchen	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom LKD	Living Room/Kitchen	2.2	Pass
Bedroom	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.8	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	0.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom LKD	Living Room/Kitchen	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom LKD	Living Room/Kitchen	1.8	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.1	Pass

12.74 Current Weather File-DSY 2

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.0	Marginally fail
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.0	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.4	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.0	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.1	Pass
L11 D3 LR	Living Room/Kitchen	1.5	Pass
L11 D4 LR	Living Room/Kitchen	2.0	Pass
L11 D2 LR	Living Room/Kitchen	1.8	Pass
L12 D3 LR	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail
LR	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	2.0	Pass
L12 D3 LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D3 LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.9	Pass
L12 D3 LR	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.5	Pass
LR	Living Room/Kitchen	1.5	Pass
L12 D3 LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.5	Pass
L12 D3 LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.2	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.2	Pass
L12 D3 LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.5	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.2	Pass
L12 D3 LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.0	Pass
LR	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.9	Pass
LR	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.2	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.0	Pass
LKD	Living Room/Kitchen	1.5	Pass
LR	Living Room/Kitchen	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.1	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.2	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
L11 D1 B2	Bedroom	2.8	Pass
L11 D2 B1	Bedroom	2.2	Pass
L11 D3 B1	Bedroom	2.4	Pass
L11 D4 B1	Bedroom	2.1	Pass
L11 D4 B2	Bedroom	2.2	Pass
L11 D5 LR / B1	Living Room/Kitchen	2.2	Pass
L11 D6 B3	Bedroom	2.3	Pass
L12 D2 B2	Bedroom	2.0	Pass
L12 D3 B1	Bedroom	2.0	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.8	Pass
L12 D6 B1	Bedroom	1.7	Pass
L12 D2 B1	Bedroom	1.8	Pass
L12 D2 B2	Bedroom	1.8	Pass
L12 D2 B1	Bedroom	2.3	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.2	Pass
Bedroom LKD	Living Room/Kitchen	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
L12 D4 B1	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
L12 D2 B2	Bedroom	2.1	Pass
L12 D3 B1	Bedroom	2.1	Pass
L12 D5 LR / B1	Living Room/Kitchen	1.9	Pass
L12 D6 B1	Bedroom	1.9	Pass
L12 D2 B1	Bedroom	1.8	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
L12 D4 B1	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
L12 D2 B2	Bedroom	2.8	Pass
L12 D3 B1	Bedroom	2.2	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.4	Pass
L12 D6 B1	Bedroom	2.1	Pass
L12 D2 B1	Bedroom	2.2	Pass
L12 D1 B2	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
L12 D4 B1	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
L12 D2 B2	Bedroom	1.8	Pass
L12 D3 B1	Bedroom	1.8	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.3	Pass
L12 D6 B1	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D2 B1	Bedroom	2.3	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
L12 D4 B1	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
L12 D2 B2	Bedroom	2.1	Pass
L12 D3 B1	Bedroom	2.1	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.5	Pass
L12 D6 B1	Bedroom	1.9	Pass
L12 D2 B1	Bedroom	1.2	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
L12 D4 B1	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
L12 D2 B2	Bedroom	2.5	Pass
L12 D3 B1	Bedroom	1.9	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.1	Pass
L12 D6 B1	Bedroom	1.0	Pass
L12 D2 B1	Bedroom	1.5	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
L12 D4 B1	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
L12 D2 B2	Bedroom	1.1	Pass
L12 D3 B1	Bedroom	1.5	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.0	Pass
L12 D6 B1	Bedroom	1.8	Pass
L12 D2 B1	Bedroom	1.8	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
L12 D4 B1	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
L12 D2 B2	Bedroom	3.1	Marginally fail
L12 D3 B1	Bedroom	2.6	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D6 B1	Bedroom	2.9	Pass
L12 D2 B1	Bedroom	2.2	Pass
L12 D1 B2	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
L12 D4 B1	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
L12 D6 B1	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
L12 D2 B2	Bedroom	1.8	Pass
L12 D2 B1	Bedroom	2.3	Pass
L12 D1 B2	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
L12 D6 B1	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom LKD	Living Room/Kitchen	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom LKD	Living Room/Kitchen	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom LKD	Living Room/Kitchen	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom LKD	Living Room/Kitchen	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom LKD	Living Room/Kitchen	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom LKD	Living Room/Kitchen	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.0	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom LKD	Living Room/Kitchen	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom LKD	Living Room/Kitchen	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass

12.75 Current Weather File-DSY-3

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.2	Pass
L11 D3 LR	Living Room/Kitchen	1.6	Pass
L11 D4 LR	Living Room/Kitchen	2.2	Pass
L11 D2 LR	Living Room/Kitchen	1.9	Pass
L12 D3 LR	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail
LR	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.4	Pass
LR	Living Room/Kitchen	2.4	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	2.2	Pass
L12 D3 LR	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D3 LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.1	Pass
L12 D3 LR	Living Room/Kitchen	1.4	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	1.6	Pass
L12 D3 LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.7	Pass
L12 D3 LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.4	Pass
L12 D3 LR	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.4	Pass
L12 D3 LR	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.1	Pass
LR	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.2	Pass
Living Room	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail
LR	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	1.7	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.1	Pass
LKD	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.2	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	3.1	Marginally fail
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	1.7	Pass
LR	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
L11 D1 B2	Bedroom	3.0	Pass
L11 D2 B1	Bedroom	2.4	Pass
L11 D3 B1	Bedroom	2.6	Pass
L11 D4 B1	Bedroom	2.3	Pass
L11 D4 B2	Bedroom	2.4	Pass
L11 D5 LR / B1	Living Room/Kitchen	2.4	Pass
L11 D6 B3	Bedroom	2.5	Pass
L12 D2 B2	Bedroom	2.2	Pass
L12 D3 B1	Bedroom	2.2	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.0	Pass
L12 D6 B1	Bedroom	1.8	Pass
L12 D2 B1	Bedroom	1.9	Pass
L12 D2 B2	Bedroom	2.0	Pass
L12 D2 B1	Bedroom	2.5	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.4	Pass
Bedroom LKD	Living Room/Kitchen	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
L12 D4 B1	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
L12 D2 B2	Bedroom	2.3	Pass
L12 D3 B1	Bedroom	2.3	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.1	Pass
L12 D6 B1	Bedroom	2.1	Pass
L12 D2 B1	Bedroom	2.0	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
L12 D4 B1	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
L12 D2 B2	Bedroom	3.0	Pass
L12 D3 B1	Bedroom	2.4	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.6	Pass
L12 D6 B1	Bedroom	2.3	Pass
L12 D2 B1	Bedroom	2.4	Pass
L12 D1 B2	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
L12 D4 B1	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
L12 D2 B2	Bedroom	1.9	Pass
L12 D3 B1	Bedroom	2.0	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.5	Pass
L12 D6 B1	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D2 B1	Bedroom	2.5	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
L12 D4 B1	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
L12 D2 B2	Bedroom	2.3	Pass
L12 D3 B1	Bedroom	2.3	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.7	Pass
L12 D6 B1	Bedroom	2.1	Pass
L12 D2 B1	Bedroom	1.3	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
L12 D4 B1	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
L12 D2 B2	Bedroom	2.7	Pass
L12 D3 B1	Bedroom	2.1	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.3	Pass
L12 D6 B1	Bedroom	1.1	Pass
L12 D2 B1	Bedroom	1.6	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
L12 D4 B1	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
L12 D2 B2	Bedroom	1.2	Pass
L12 D3 B1	Bedroom	1.6	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.2	Pass
L12 D6 B1	Bedroom	1.9	Pass
L12 D2 B1	Bedroom	2.0	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
L12 D4 B1	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
L12 D2 B2	Bedroom	3.3	Marginally fail
L12 D3 B1	Bedroom	2.8	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D6 B1	Bedroom	3.1	Marginally fail
L12 D2 B1	Bedroom	2.4	Pass
L12 D1 B2	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
L12 D4 B1	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
L12 D6 B1	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
L12 D2 B2	Bedroom	2.0	Pass
L12 D2 B1	Bedroom	2.5	Pass
L12 D1 B2	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
L12 D6 B1	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom LKD	Living Room/Kitchen	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom LKD	Living Room/Kitchen	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom LKD	Living Room/Kitchen	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom LKD	Living Room/Kitchen	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom LKD	Living Room/Kitchen	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	1.7	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.1	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.2	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom LKD	Living Room/Kitchen	2.2	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	3.1	Marginally fail
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom LKD	Living Room/Kitchen	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass

12.76 Future Weather File H 2050

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.5	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.4	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.5	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.1	Marginally fail
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	3.5	Marginally fail
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	3.5	Marginally fail
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.2	Marginally fail
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	3.6	Fail
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	3.6	Fail
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.4	Pass
Living Room	Living Room/Kitchen	3.3	Marginally fail
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	2.4	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.7	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.8	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	2.0	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	3.0	Pass
Living Room	Living Room/Kitchen	3.4	Marginally fail
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.2	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.7	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.6	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	1.9	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	1.5	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.6	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.3	Pass
Living Room	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
L11 D3 LR	Living Room/Kitchen	1.8	Pass
L11 D4 LR	Living Room/Kitchen	2.4	Pass
L11 D2 LR	Living Room/Kitchen	2.1	Pass
L12 D3 LR	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	3.5	Marginally fail
LR	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	3.2	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.6	Pass
LR	Living Room/Kitchen	2.6	Pass
LR	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.4	Pass
LR	Living Room/Kitchen	2.4	Pass
L12 D3 LR	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	2.0	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D3 LR	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.7	Pass
LR	Living Room/Kitchen	2.3	Pass
L12 D3 LR	Living Room/Kitchen	1.6	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	1.8	Pass
L12 D3 LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.9	Pass
L12 D3 LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.5	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.6	Pass
L12 D3 LR	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.6	Pass
L12 D3 LR	Living Room/Kitchen	2.9	Pass
LR	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	1.3	Pass
LR	Living Room/Kitchen	1.8	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.1	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	2.9	Pass
Living Room	Living Room/Kitchen	2.3	Pass
Living Room	Living Room/Kitchen	2.5	Pass
Living Room	Living Room/Kitchen	1.4	Pass
Living Room	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.4	Pass
LR	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.2	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	3.5	Marginally fail

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail
LR	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	3.2	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LR	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.9	Pass
LR	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	1.9	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.3	Pass
LKD	Living Room/Kitchen	1.8	Pass
LR	Living Room/Kitchen	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	1.4	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	3.5	Marginally fail
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.0	Pass
LKD	Living Room/Kitchen	3.3	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	3.2	Marginally fail
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.8	Pass
LKD	Living Room/Kitchen	2.5	Pass
LR	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.4	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.0	Pass
LKD	Living Room/Kitchen	2.1	Pass
LKD	Living Room/Kitchen	2.2	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.7	Pass
LKD	Living Room/Kitchen	2.3	Pass
LR	Living Room/Kitchen	1.6	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	1.9	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	1.5	Pass
LKD	Living Room/Kitchen	2.5	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	1.9	Pass
LR	Living Room/Kitchen	1.8	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.6	Pass
LKD	Living Room/Kitchen	2.9	Pass
LKD	Living Room/Kitchen	2.3	Pass
LKD	Living Room/Kitchen	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
L11 D1 B2	Bedroom	3.2	Marginally fail
L11 D2 B1	Bedroom	2.6	Pass
L11 D3 B1	Bedroom	2.8	Pass
L11 D4 B1	Bedroom	2.5	Pass
L11 D4 B2	Bedroom	2.6	Pass
L11 D5 LR / B1	Living Room/Kitchen	2.6	Pass
L11 D6 B3	Bedroom	2.7	Pass
L12 D2 B2	Bedroom	2.4	Pass
L12 D3 B1	Bedroom	2.4	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.2	Pass
L12 D6 B1	Bedroom	2.0	Pass
L12 D2 B1	Bedroom	2.1	Pass
L12 D2 B2	Bedroom	2.2	Pass
L12 D2 B1	Bedroom	2.7	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.6	Pass
Bedroom LKD	Living Room/Kitchen	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
L12 D1 B2	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
L12 D4 B1	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
L12 D2 B2	Bedroom	2.5	Pass
L12 D3 B1	Bedroom	2.5	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.3	Pass
L12 D6 B1	Bedroom	2.3	Pass
L12 D2 B1	Bedroom	2.2	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
L12 D4 B1	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
L12 D2 B2	Bedroom	3.2	Marginally fail
L12 D3 B1	Bedroom	2.6	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.8	Pass
L12 D6 B1	Bedroom	2.5	Pass
L12 D2 B1	Bedroom	2.6	Pass
L12 D1 B2	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
L12 D4 B1	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
L12 D2 B2	Bedroom	2.1	Pass
L12 D3 B1	Bedroom	2.2	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.7	Pass
L12 D6 B1	Bedroom	2.3	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D2 B1	Bedroom	2.7	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
L12 D4 B1	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
L12 D2 B2	Bedroom	2.5	Pass
L12 D3 B1	Bedroom	2.5	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.9	Pass
L12 D6 B1	Bedroom	2.3	Pass
L12 D2 B1	Bedroom	1.5	Pass
L12 D1 B2	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
L12 D4 B1	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
L12 D2 B2	Bedroom	2.9	Pass
L12 D3 B1	Bedroom	2.3	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.5	Pass
L12 D6 B1	Bedroom	1.3	Pass
L12 D2 B1	Bedroom	1.8	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
L12 D4 B1	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
L12 D2 B2	Bedroom	1.4	Pass
L12 D3 B1	Bedroom	1.8	Pass
L12 D5 LR / B1	Living Room/Kitchen	2.4	Pass
L12 D6 B1	Bedroom	2.1	Pass
L12 D2 B1	Bedroom	2.2	Pass
L12 D1 B2	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
L12 D4 B1	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
L12 D2 B2	Bedroom	3.5	Marginally fail
L12 D3 B1	Bedroom	3.0	Pass
L12 D5 LR / B1	Living Room/Kitchen	3.0	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
L12 D6 B1	Bedroom	3.3	Marginally fail
L12 D2 B1	Bedroom	2.6	Pass
L12 D1 B2	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
L12 D4 B1	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
L12 D6 B1	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
L12 D2 B2	Bedroom	2.2	Pass
L12 D2 B1	Bedroom	2.7	Pass
L12 D1 B2	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
L12 D6 B1	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom LKD	Living Room/Kitchen	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom LKD	Living Room/Kitchen	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom LKD	Living Room/Kitchen	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom LKD	Living Room/Kitchen	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.6	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom LKD	Living Room/Kitchen	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	1.5	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	1.9	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.3	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.9	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	1.4	Pass
Bedroom	Bedroom	1.8	Pass
Bedroom LKD	Living Room/Kitchen	2.4	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.5	Pass

Space Name (Real)	Thermal Template (Real)	Air temperature (°C) - % hours in range	Status
		> 26.00	
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	3.5	Marginally fail
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.0	Pass
Bedroom	Bedroom	3.3	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	3.2	Marginally fail
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.8	Pass
Bedroom	Bedroom	2.5	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.6	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.4	Pass
Bedroom LKD	Living Room/Kitchen	2.4	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.0	Pass
Bedroom	Bedroom	2.1	Pass
Bedroom	Bedroom	2.2	Pass
Bedroom	Bedroom	2.7	Pass
Bedroom	Bedroom	2.3	Pass
Bedroom	Bedroom	2.7	Pass

APPENDIX H GLA Carbon Emissions Reporting Spreadsheet

TABLE 1. APPLICATION COMPLETENESS CHECK	
Development information tab (Tables 1-4) completed and included in appendix of energy strategy?	yes
Part L outputs tab completed	yes
EUI & space heating demand completed	yes
Confirmation that the planning stage webform will be completed at planning application submission and that the Be Seen process and reporting responsibilities are fully understood, including the requirement for as-built and in-use stage reporting to be undertaken (or where the legal owner changes from one reporting stage to another that the responsible party will be notified).	yes

TABLE 2. DEVELOPMENT DETAILS		Further notes	Response	Supporting comments (or signpost sections in the energy assessment)
Application details	Date of Application	Please provide the date the application was submitted to the Local Planning Authority.		
	Local Planning Authority	Please indicate the Local Planning Authority determining the application.	Southwark	
	Confirmed carbon offset price (£/tonne of carbon dioxide)	Please confirm the agreed carbon offset price for the Local Planning Authority. If no value is entered then the GLA's recommend price of £95 per tonne of carbon dioxide will be used.	95.00	
	Evidence of communication on the carbon offset price included in the energy assessment (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	Residential units number (Part L1)		877	
Heat risk	Non-residential floor area in m ² (Part L2)		8791.62	
	CIBSE TM59 undertaken for residential development (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	CIBSE TM52 undertaken for non-residential development (Y/N)		Y	All non-residential developments are provided with cooling
	All sample units meet CIBSE criteria with DSY1 weather file (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	DSY2 and DSY3 included in overheating assessments (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
Energy efficiency measures	Residential g-value		0.40	Refer to Energy Statement and Overheating Assessment
	% Glazing Ratio over façade			
	External shading proposed (Y/N)		Y	Balconies structure provide shading for balcony adjacent to glazing
	Target Fabric Energy Efficiency met (Y/N)		Y	
	Mechanical Ventilation with Heat Recovery included (Y/N)		Y	
District heating connection	Waste Water Heat Recovery (Y/N)		N	
	Low energy lighting (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	Development in a Heat Network Priority Area (HNPA) (Y/N)		N	
	District Heating Network connection (Y/N)		N	
	Name of District Heating Network		N/A	
Site heating distribution configuration	Carbon factor (kgCO ₂ /kWh)		N/A	
	Borough energy officer and Heat Network Operator contacted and evidence of correspondence included in the energy strategy (Y/N)	Applicable to all applications.	Y	SELCHP
	Development future proofed for DHN connection (Y/N)	Note that individual heating systems would not be appropriate for developments in HNPA's.	Y	Refer to Energy Statement and Overheating Assessment
	Drawings of communal system provided (Y/N)	Applicants should provide a drawings of the energy centre, on-site communal network with all building uses connected and future proofing arrangements detailed, including single point of connection.	Y	Refer to Energy Statement and Overheating Assessment
	Distribution type		communal system (building level)	
Heating system performance	Flow temperature (°C)		50.00	TBC with mechanical team
	Return temperature (°C)		65.00	TBC with mechanical team
	Distribution losses modelled (%)	See table 4 below for details.	1.50	Default
	Heat Pump (Y/N)		Y	
	Heat Pump source		Air Source Heat Pump	
	Centralised Heat Pump capacity (kWth)		3810.00	
	Heat Pump Seasonal Heating Efficiency (SCoP)		Non-residential Space Heating	Refer to Energy Statement and Overheating Assessment
	Heat Pump SCoP calculation includes heat source and heat distribution temperature and seasonal performance factor (Y/N)	See table 5 below for details.	Y	
	Fraction of heat supplied by heat pump (only for hybrid systems with boilers) (%)		N/A	
	Low-emission on-site CHP enabling an area-wide heat network (Y/N)	Only low-emission CHP is suitable and only where it is facilitating an area-wide heat network. Therefore, new gas engine CHP is not suitable for any other purpose for new developments.	N	
	CHP (kW _e)		N/A	
	Estimated end user cost (pence/kWh)		N/A	
	Energy assessment includes consideration of occupant running costs (Y/N)	Applicants should consider the estimated costs to occupants of the energy assessment and outline how they are committed to protecting the consumer from high prices.	Y	Refer to Energy Statement and Overheating Assessment
Solar technologies	Solar PV included (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	Roof layout demonstrating solar PV technologies have been maximised included in energy strategy (Y/N)		Y	Refer to Energy Statement and Overheating Assessment
	kWh generated		66587.20	Commercial = 24952.6 kWh, Communal Corridors = 4166.6 kWh
	kWp		164.82	
	Total PV panel area (m ²) installed		820.00	Refer to Energy Statement and Overheating Assessment
Flexibility and peak energy demand	Solar Thermal included (Y/N)		N	
	Solar Thermal panel area (m ²) installed		N/A	
	Site-wide peak demand, capacity and flexibility potential included in energy assessment (Y/N)	Table 9 in the energy assessment guidance to be completed.	N	The PV layouts will be fully utilised at the time of generation
	Interventions for achieving flexibility included in energy assessment (Y/N)	Table 10 in the energy assessment guidance to be completed.	N	
	Estimated peak demand (MW)		N/A	
Other technologies	Electrical energy storage (kWh) capacity		N/A	
	Heat energy storage (kWh) capacity		N/A	
	System type (e.g. wind turbine)		N/A	
Cooling	Capacity (kW)		N/A	
	Cooling proposed - Residential (Y/N)	It is not expected that 'active cooling' will be proposed for any residential developments. It will be expected that applicants can fully demonstrate that all passive design measures have been thoroughly investigated before considering 'active cooling'.	Y	
	Cooling proposed - Non-residential (Y/N)		Y	
	Residential Cooling consumption (kWh p.a.)	See note in cell C60.	N/A	Maximised passive ventilation in residential areas.
	Commercial Cooling consumption (MJ p.a.)		898947.39	Refer to Energy Statement and Overheating Assessment

TABLE 3. BESPOKE DH CARBON FACTOR CALCULATION METHODOLOGY				
Please provide below details of the calculation methodology followed to establish the bespoke carbon factor, if applicable.				

TABLE 4. DISTRIBUTION LOSSES				COMMENTS
Primary network (buried pipe)	Total pipe length (m)			
	Average heat loss rate (W/m)			
Secondary network (buried pipe)	Total pipe length (m)			
	Average heat loss rate (W/m)			
Total losses (MWh/year)				
Total heat supplied (MWh/year)				
Distribution Loss Factor (DLF)				
Calculation included in energy statement (yes/no)				

TABLE 5. SEASONAL COEFFICIENT OF PERFORMANCE (SCOP) CALCULATION METHODOLOGY				
Details of the Seasonal Coefficient of Performance (SCOP), the Seasonal Performance Factor (SPF) and Seasonal Energy Efficiency ratio (SEER), which should be used in the energy modelling. This should be based on a dynamic calculation of the system boundaries over the course of a year i.e. incorporating variations in source temperatures and the design sink temperatures (for space heat and hot water). Details of the assumptions should be included in the energy assessment, including manufacturer datasheets showing performance under test conditions for the specific source and sink temperatures of the proposed development and assumptions for hours spent under changing source temperatures.				

The applicant should complete all the light blue cells including information on the modelled units, the area per unit, the number of units, the TER/DER/BER and the TFE/DFEE.																				
RESIDENTIAL CO ₂ ANALYSIS (PART L1)																				
				Baseline		'Be Lean'	'Be Clean'	'Be Green'	Fabric Energy Efficiency (FEE)		Baseline		'Be Lean'			'Be Clean'			'Be Green'	
Unit identifier (e.g. plot number, dwelling type etc.)	Model total floor area	Number of units	Total area represented by model	TER	Energy saving/generation technologies (-)	DER	DER	DER	Target Fabric Energy Efficiency	Dwelling Fabric Energy Efficiency	Part L 2021 CO ₂ emissions	Energy saving/generation technologies	Part L 2021 CO ₂ emissions	Part L 2021 CO ₂ emissions with Notional PV savings included	'Be Lean' savings	Part L 2021 CO ₂ emissions	Part L 2021 CO ₂ emissions with Notional PV savings included	'Be Clean' savings	Part L 2021 CO ₂ emissions	'Be Green' savings
	(m ²)		(m ²)	(kgCO ₂ / m ²)	(kgCO ₂ p.a.)	(kgCO ₂ / m ²)	(kgCO ₂ / m ²)	(kgCO ₂ / m ²)	(kWh/m ²)	(kWh/m ²)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)
(Row 4)				(Row 273)	(Row 269)	(Row 273 or 384)	(Row 273 or 384)	(Row 273 or 384)												
Block ABC	4581	65	4581	13.13	-4446.11	12.18	12.18	5.14	31.18	34.45	60,149	-4,446	55,797	51,350	8,798	55,797	51,350	0	23,546	27,804
Block E	4643	79	4643	13.74	-2721.09	12.22	12.22	5.13	28.63	30.40	63,795	-2,721	56,737	54,016	9,778	56,737	54,016	0	23,819	30,198
Block F	1704	20	1704	11.58	-1807.78	10.69	10.69	4.39	28.94	31.97	19,732	-1,808	18,216	16,408	3,324	18,216	16,408	0	7,481	8,927
Block G	4811	71	4811	12.84	-2611.41	11.43	11.43	4.94	28.72	30.90	61,773	-2,611	54,990	52,378	9,395	54,990	52,378	0	23,766	28,612
Block H	3451	43	3451	11.78	-2436.85	10.48	10.48	4.53	26.64	29.50	40,653	-2,437	36,166	33,730	6,923	36,166	33,730	0	15,633	18,097
Block J1J2	8851	129	8851	12.32	-4353.10	10.68	10.68	4.56	24.64	26.29	109,044	-4,353	94,529	90,176	18,869	94,529	90,176	0	40,361	49,815
Block K	5897	85	5897	12.06	-3705.50	10.64	10.64	4.56	25.07	27.22	71,118	-3,705	62,744	59,039	12,079	62,744	59,039	0	26,890	32,148
Block L	5675	85	5675	12.25	-3353.99	10.55	10.55	4.60	24.43	25.06	69,519	-3,354	59,871	56,517	13,001	59,871	56,517	0	26,105	30,412
Block M	10790	149	10790	12.53	-3319.61	10.35	10.35	4.54	26.37	26.69	135,199	-3,320	111,677	108,357	26,842	111,677	108,357	0	48,987	59,370
Block N	3632	64	3632	13.52	-1771.89	12.10	12.10	5.37	24.65	27.07	49,105	-1,772	43,947	42,175	6,929	43,947	42,175	0	19,504	22,671
Block P	4362	50	4362	11.22	-2319.19	9.73	9.73	4.07	25.48	28.33	48,942	-2,319	42,442	40,123	8,819	42,442	40,123	0	17,753	22,370
Block Q	2056	27	2056	11.80	-2156.20	10.92	10.92	4.74	26.83	29.97	24,261	-2,156	22,452	20,295	3,965	22,452	20,295	0	9,745	10,550
Sum		867	60,453	12.5	-3,197.1	10.9	10.9	4.7	26.5	28.3	753,288	-35,003	659,568	624,565	128,724	659,568	624,565	0	283,590	340,975
NON-RESIDENTIAL CO ₂ ANALYSIS (PART L2)																				
				Baseline		'Be Lean'	'Be Clean'	'Be Green'			Baseline		'Be Lean'			'Be Clean'			'Be Green'	
Building Use	Model Area	Number of units	Total area represented by model	BRUKL TER	BRUKL Displaced electricity (-)	BRUKL BER	BRUKL BER	BRUKL BER			Part L 2021 CO ₂ emissions	Energy saving/generation technologies	Part L 2021 CO ₂ emissions	Part L 2021 CO ₂ emissions with Notional PV savings included	'Be Lean' savings	Part L 2021 CO ₂ emissions	Part L 2021 CO ₂ emissions with Notional PV savings included	'Be Clean' savings	Part L 2021 CO ₂ emissions	'Be Green' savings
	(m ²)		(m ²)	(kgCO ₂ / m ²)	(kWh / m ²)	(kgCO ₂ / m ²)	(kgCO ₂ / m ²)	(kgCO ₂ / m ²)			(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)	(kgCO ₂ p.a.)
Block ABC - Com	1245.2	1	1245.2	5.42		4.40	4.40	3.50			6,749	0.00	5,478.88	5,479	1,270	5,479	5,479	0	4,358	1,121
Block D - Comme	2725.3	1	2725.3	3.42		2.82	2.82	2.21			9,321	0.00	7,685.35	7,685	1,635	7,685	7,685	0	6,023	1,662
Block E - Comme	341	1	341	11.28		9.11	9.11	6.96			3,846	0.00	3,106.51	3,107	740	3,107	3,107	0	2,373	733
Block F - Comme	208.2	1	208.2	10.46		8.24	8.24	4.99			2,178	0.00	1,715.57	1,716	462	1,716	1,716	0	1,039	677
Block G - Comme	276.2	1	276.2	10.48		8.49	8.49	6.50			2,895	0.00	2,344.94	2,345	550	2,345	2,345	0	1,795	550
Block H - Comme	244.2	1	244.2	13.06		10.73	10.73	7.97			3,189	0.00	2,620.27	2,620	569	2,620	2,620	0	1,946	674
Block J1J2 - Com	125.3	1	125.3	5.89		4.94	4.94	3.51			738	0.00	618.98	619	119	619	619	0	440	179
Block K - Comme	1259.4	1	1259.4	4.78		3.95	3.95	3.09			6,020	0.00	4,974.63	4,975	1,045	4,975	4,975	0	3,892	1,083
Block L - Comme	16.5	1	16.5	6.61		5.46	5.46	3.70			109	0.00	90.09	90	19	90	90	0	61	29
Block N - Comme	97.4	1	97.4	5.55		4.36	4.36	3.34			541	0.00	424.66	425	116	425	425	0	325	99
Morrisons - Comm	2252.92	1	2252.92	4.94		4.18	4.18	3.20			11,129	0.00	9,417.21	9,417	1,712	9,417	9,417	0	7,209	2,208
ABC	371	1	371	1.24	-4.70	1.41	1.41	0.80			460	-224.49	523.11	299	161	523	299	0	297	2
D	153	1	153	2.53	-6.58	2.72	2.72	1.64			387	-129.61	416.16	287	101	416	287	0	251	36
E	593.1	1	593.1	0.81	-3.29	0.91	0.91	0.52			480	-251.22	539.72	289	192	540	289	0	308	-20
F	244.6	1	244.6	0.60	-5.48	1.00	1.00	0.38			147	-172.57	244.60	72	75	245	72	0	93	-21
G	859	1	859	1.22	-2.74	1.10	1.10	0.79			1,047	-302.67	943.80	641	406	944	641	0	678	-37
H	582.2	1	582.2	1.08	-3.66	0.98	0.98	0.66			629	-274.33	570.56	296	333	571	296	0	384	-88
J1J2	1196.3	1	1196.3	0.95	-1.94	0.98	0.98	0.60			1,136	-298.79	1,172.37	874	263	1,172	874	0	718	156
K	1120.8	1	1120.8	1.00	-3.29	0.90	0.90	0.64			1,121	-474.73	1,008.72	534	587	1,009	534	0	717	-183
L	874.1	1	874.1	0.93	-2.99	0.84	0.84	0.56			813	-336.48	734.24	398	415	734	398	0	489	-92
M	2207.5	1	2207.5	0.82	-1.57	0.78	0.78	0.51			1,810	-446.20	1,721.85	534	534	1,722	1,276	0	1,126	150
N	797.5	1	797.5	1.75	-2.53	1.66	1.66	1.06			1,396	-259.76	1,323.85	1,064	332	1,324	1,064	0	845	219
P	891.2	1	891.2	1.06	-2.74	1.07	1.07	0.66			945	-314.38	953.58	639	305	954	639	0	588	51
Q	453.3	1	453.3	1.05	-5.48	1.35	1.35	0.63			476	-319.81	611.96	292	184	612	292	0	286	7
Sum		24	19,134	3.0	-1.5	2.6	2.6	1.9			57,561	-3,805	49,242	45,437	12,124	49,242	45,437	0	36,243	9,194
SITE-WIDE ENERGY CONSUMPTION AND CO ₂ ANALYSIS																				
Total Sum			79,587	-	-	-	-	-			810,849	-38,808	708,809	670,001	140,848	708,809	670,001	0	319,833	350,169

Part L 2021 Performance

Residential


Table 1: Carbon Dioxide Emissions after each stage of the Energy Hierarchy for residential buildings

	Carbon Dioxide Emissions for residential buildings (Tonnes CO ₂ per annum)	
	Regulated	Unregulated
Baseline: Part L 2021 of the Building Regulations Compliant Development	753.3	34.5
After energy demand reduction (be lean)	624.6	34.5
After heat network connection (be clean)	624.6	34.5
After renewable energy (be green)	283.6	34.5

Table 2: Regulated Carbon Dioxide savings from each stage of the Energy Hierarchy for residential buildings

	Regulated residential carbon dioxide savings	
	(Tonnes CO ₂ per annum)	(%)
Be lean: savings from energy demand reduction	128.7	17%
Be clean: savings from heat network	0.0	0%
Be green: savings from renewable energy	341.0	45%
Cumulative on site savings	469.7	62%
Annual savings from off-set payment	283.6	-
(Tonnes CO ₂)		
Cumulative savings for off-set payment	8,508	-
Cash in-lieu contribution (£)	808,231	

*carbon price is based on GLA recommended price of £95 per tonne of carbon dioxide unless Local Planning Authority price is inputted in the 'Development

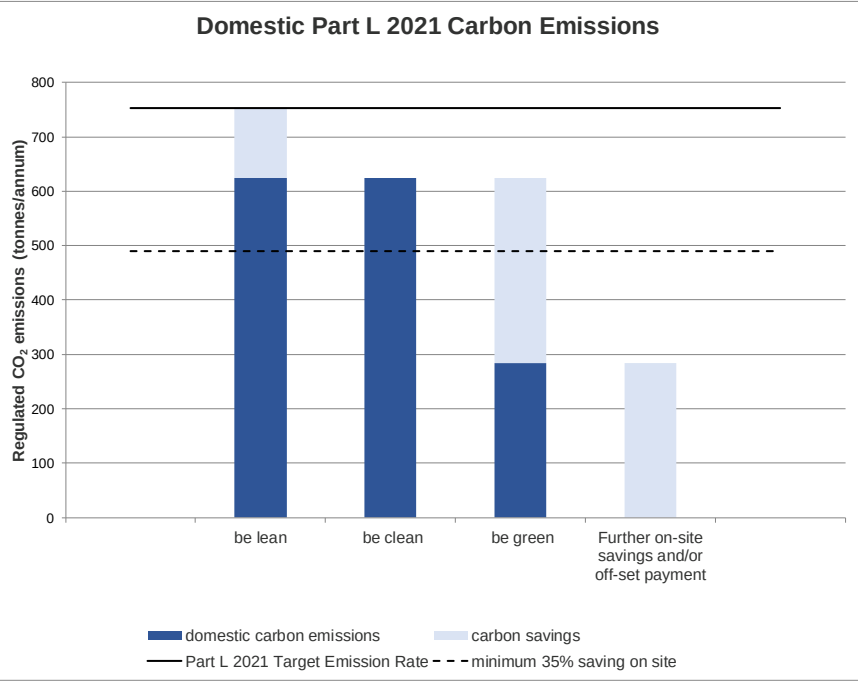

Non-residential


Table 3: Carbon Dioxide Emissions after each stage of the Energy Hierarchy for non-residential buildings

	Carbon Dioxide Emissions for non-residential buildings (Tonnes CO ₂ per annum)	
	Regulated	Unregulated
Baseline: Part L 2021 of the Building Regulations Compliant Development	57.6	13.6
After energy demand reduction (be lean)	45.4	13.6
After heat network connection (be clean)	45.4	13.6
After renewable energy (be green)	36.2	13.6

Table 4: Regulated Carbon Dioxide savings from each stage of the Energy Hierarchy for non-residential buildings

	Regulated non-residential carbon dioxide savings	
	(Tonnes CO ₂ per annum)	(%)
Be lean: savings from energy demand reduction	12.1	21%
Be clean: savings from heat network	0.0	0%
Be green: savings from renewable energy	9.2	16%
Total Cumulative Savings	21.3	37%
Annual savings from off-set payment	36.2	-
(Tonnes CO ₂)		
Cumulative savings for off-set payment	1,087	-
Cash in-lieu contribution (£)	103,292	

*carbon price is based on GLA recommended price of £95 per tonne of carbon dioxide unless Local Planning Authority price is inputted in the 'Development

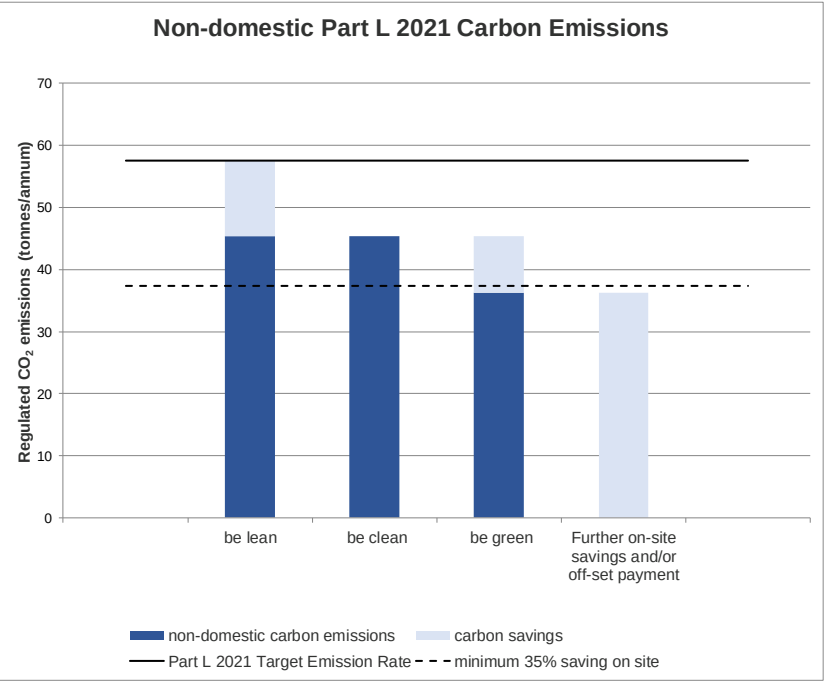

EUI & space heating demand (predicted energy use)

Residential

Building type	EUI (kWh/m ² /year) (excluding renewable energy)	Space heating demand (kWh/m ² /year) (excluding renewable energy)	EUI value from Table 4 of the guidance (kWh/m ² /year) (excluding renewable energy)	Space heating demand from Table 4 of the guidance(kWh/m ² /year) (excluding renewable energy)	Methodology used (e.g. 'be seen' methodology or an alternative predictive energy modelling methodology)	Explanatory notes (if expected performance differs from the Table 4 values in the guidance)
Residential	58.05490272	13.38573768	35	15	Part L1 - SAP 10.2 & CIBSE TM54 dwellings / & Landlord Circulation	EUI exceedance is driven by unregulated load including cooking and appliances. This is applicable to residential and commercial EUI. The GLA Table 4 EUI targets are informed by LETI typologies for medium housing which assume the use of operable windows and cross ventilation

Non-residential

Building type	EUI (kWh/m ² /year) (excluding renewable energy)	Space heating demand (kWh/m ² /year) (excluding renewable energy)	EUI value from Table 4 of the guidance (kWh/m ² /year) (excluding renewable energy)	Space heating demand from Table 4 of the guidance(kWh/m ² /year) (excluding renewable energy)	Methodology used (e.g. 'be seen' methodology or an alternative predictive energy modelling methodology)	Explanatory notes (if expected performance differs from the Table 4 values in the guidance)
All other non-residential	48.19	22.25	55	15	Part L2 - SBEM & CIBSE TM54	ABC
Office	61	9.95	55	15	Part L2 - SBEM & CIBSE TM54	D
All other non-residential	140.12	40	55	15	Part L2 - SBEM & CIBSE TM54	E
All other non-residential	161.77	24.15	55	15	Part L2 - SBEM & CIBSE TM54	F
All other non-residential	128.64	52.4	55	15	Part L2 - SBEM & CIBSE TM54	G
All other non-residential	154.7	65.3	55	15	Part L2 - SBEM & CIBSE TM54	H
All other non-residential	52.87	27.1	55	15	Part L2 - SBEM & CIBSE TM54	J1J2
All other non-residential	47.04	13.45	55	15	Part L2 - SBEM & CIBSE TM54	K
All other non-residential	53.96	34.05	55	15	Part L2 - SBEM & CIBSE TM54	L
All other non-residential	51.28	10.05	55	15	Part L2 - SBEM & CIBSE TM54	N
All other non-residential	51.29	0.4	55	15	Part L2 - SBEM & CIBSE TM54	Morrisons

APPENDIX I GLA Be Seen Monitoring Reporting Spreadsheet

OVERALL PROGRESS		100%
CURRENT REPORTING STAGE	Planning	*
CONTEXTUAL DATA		
Progress: 100%		
+ ORGANISATION & CONTACT DETAILS		
+ DEVELOPMENT INFORMATION		
OVERALL DEVELOPMENT DETAILS		
Planning Reference Number	24/AP/2074	
Name of Whole Development	Aylesham Centre	
DEVELOPMENT LOCATION		
Development Address		
Address Line 1	Aylesham Centre	
Address Line 2	Hanover Park	
Address Line 3	London	
Address Line 4		
London Borough	Southwark	
Postcode	SE15 5EW	
Ordinance Survey Reference		
Development UPRN (if available)	TBC	
Geo-Location Coordinates		
Latitude (to 6 decimal places)	51.500	
Longitude (to 6 decimal places, +ve or -ve)	0.128	
DEVELOPMENT TOTAL AREA BREAKDOWN		
Residential		
Total Residential Floor Area	GIA m2	79,258
Dwelling Counts		
Flats	number	867
House	number	0
Non-Residential		
Non-Residential Floor Area Breakdown		Please include complete non-resi details below
Landlord Circulation (in Residential Blocks)	GIA m2	10,343
General office (A2, B1, B8, D1 planning classes)	GIA m2	2,725
High street agency (A2 planning classes)	GIA m2	
General retail (A1, SG planning classes)	GIA m2	6,538
Large non-food shop (A1 planning classes)	GIA m2	
Small food store	GIA m2	
Large food store	GIA m2	4,436
Restaurant (A3, A5 planning classes)	GIA m2	
Bar, pub or licensed club (A4 planning classes)	GIA m2	
Hotel (C1 planning classes)	GIA m2	
Cultural Activities	GIA m2	
Entertainment halls (D2 planning classes)	GIA m2	
Swimming pool centre	GIA m2	
Fitness and health centre	GIA m2	
Dry sports and leisure facility (D2 planning classes)	GIA m2	
Covered car park	GIA m2	
Public buildings with light usage (D1, SG planning classes)	GIA m2	
Schools and seasonal public buildings (D1, D2 planning classes)	GIA m2	
University campus	GIA m2	
Clinic (D1 planning classes)	GIA m2	
Hospital (clinical and research)	GIA m2	
Long term residential (C1, C2, C2A planning classes)	GIA m2	
General accommodation (C1, C2, C3 planning classes)	GIA m2	
Emergency services (SG planning classes)	GIA m2	
Laboratory or operating theatre	GIA m2	
Public waiting or circulation (SG planning classes)	GIA m2	
Terminal (B8 planning classes)	GIA m2	
Workshop (B1, B2 planning classes)	GIA m2	
Storage Facility (B8 planning classes)	GIA m2	
Cold Storage (B8 planning classes)	GIA m2	
Overall Development Summary		
Total Development Floor Area		
Residential	GIA m2	79,258
Non-Residential	GIA m2	24,042
Total	GIA m2	103,301
Total Non-Residential Uses		Landlord Circulation; General office; General retail; Large food store

+ SUPPLEMENTARY FILES AND UPCOMING REPORTING STAGES																		
DEVELOPMENT PERFORMANCE AND EMISSIONS					Progress: 100%													
+ DEVELOPMENT PERFORMANCE																		
DEVELOPMENT OVERALL PREDICTED PERFORMANCE																		
Predicted Performance Calculation Details																		
Fuel Carbon Intensity Source (aligned with planning energy statemen					SAP 10.2		*											
Residential Elements of the development					Fill in all applicable fuels below													
Predicted Annual Energy Use																		
Annual Electricity Use		kWh/yr		2,740,085		*												
Annual Gas Use		kWh/yr		0		*												
Annual Oil Use (if applicable)		kWh/yr				*												
Annual Biomass Use (if applicable)		kWh/yr				*												
Annual District Htg Use (if applicable)		kWh/yr		1,369,947		*												
Annual District Clg Use (if applicable)		kWh/yr				*												
Elec Generation, Gross (if applicable)		kWh/yr				*												
Solar Thermal Generation (if applicable)		kWh/yr				*												
Predicted Annual Carbon Emissions		tCO2/yr		273,536		*												
Non-Residential Elements of the development (Part L Calculation)					Fill in all applicable fuels below													
Predicted Annual Energy Use																		
Annual Electricity Use		kWh/yr		568,323		*												
Annual Gas Use		kWh/yr		0		*												
Annual Oil Use (if applicable)		kWh/yr				*												
Annual Biomass Use (if applicable)		kWh/yr				*												
Annual District Htg Use (if applicable)		kWh/yr				*												
Annual District Clg Use (if applicable)		kWh/yr				*												
Elec Generation, Gross (if applicable)		kWh/yr				*												
Solar Thermal Generation (if applicable)		kWh/yr				*												
Predicted Annual Carbon Emissions		tCO2/yr		36,460		*												
Non-Residential Elements of the development (TM54 Calculation)					Fill in all applicable fuels below													
Predicted Annual Energy Use																		
Annual Electricity Use		kWh/yr		568,323		*												
Annual Gas Use		kWh/yr		0		*												
Annual Oil Use (if applicable)		kWh/yr				*												
Annual Biomass Use (if applicable)		kWh/yr				*												

APPENDIX J SELCHP Correspondence

From: Sousa, João <joao.sousa@veolia.com>
Sent: 09 April 2025 17:03
To: Mohamed Mekkawy
Cc: Henry Warren-Jones; Kieran Bruce; Amal Raphael
Subject: Re: SELCHP - Contact Form Enquiry

Yes, this is correct.

On Wed, Apr 9, 2025 at 12:47 PM Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com> wrote:

Hi Joao,

Just following up on the below, could you please confirm whether my understanding is correct, and correct me if I missed anything?

I appreciate your assistance.

Regards,

Mo

Mohamed Mekkawy MSc in CFD, LEED AP® BD+C WELL AP, BREEAM Assessor, CIBSE LCC LCEA ASHRAE CPD BEMP HBDI
Senior Associate | Building Physics Engineer
mobile: +44 7394 570 490
Mohamed.Mekkawy@me-engineers.com
me | engineers

From: Mohamed Mekkawy
Sent: 08 April 2025 17:03
To: Sousa, João <joao.sousa@veolia.com>
Cc: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>; Kieran Bruce <kieran.bruce@veolia.com>; Amal Raphael <amal.rafael@veolia.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

Thank you for the feedback much appreciated.

Just to confirm my understanding, initially Hybrid solution with onsite heat network/generation along with connection to SELCHP heat network will be an ideal solution providing both the demand and needed backup. This will also reduce the capacity allocation to the site resulting in lower standing charges.

3 connection is acceptable given that:

- 1. Secondary network is provided within the site to facilitate such connections.
- 2. 24/7 Accessibility is provided for maintenance and operation for primary network linked to the heat network (i.e. Heat exchanger flow and return pipes)

Noted for the connection point, we will update the schematics accordingly.


Regards,

Mo

From: Sousa, João <joao.sousa@veolia.com>
Sent: 08 April 2025 16:28
To: Mohamed Mekkawy
Cc: Henry Warren-Jones; Kieran Bruce; Amal Raphael
Subject: Re: SELCHP - Contact Form Enquiry
Attachments: 20230328 District Heating Connection Process Ver03.pptx (1).pdf

Hi Mohamed

- The closest point to connect to the district heating network most likely will be Wood's Road (tbc) or alternatively close to Linsford Street in Surrey Canal Walk

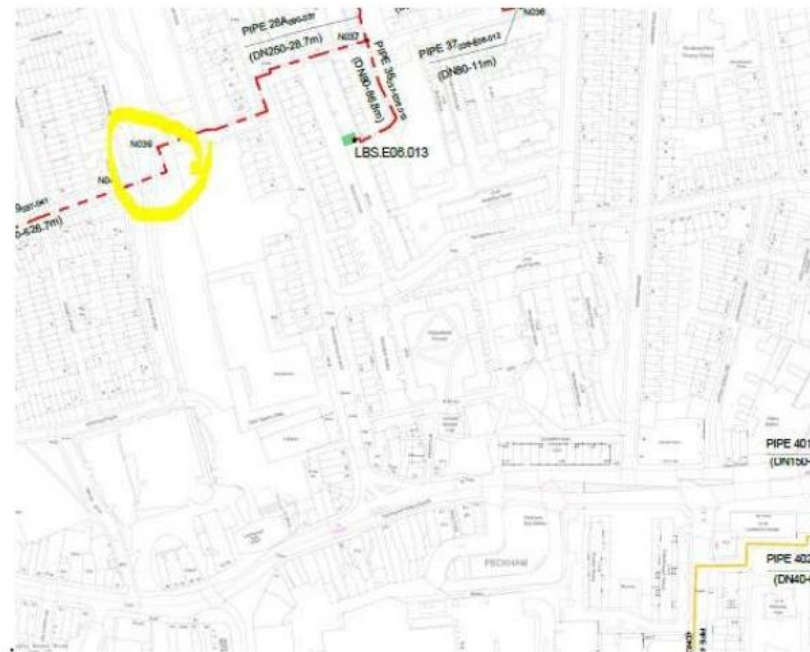

- It is envisaged that Veolia through additional modifications to DH exporting facilities will have sufficient capacity to supply your development in a interrupted basis (no backup guarantee).
- With an on-site backup and peaking plant, the development can achieve a very good hybrid solution by contracting much lower capacity from the DH DNO which is driven by standing charges;

- 3 Connections will be acceptable; however I highlight that will result in higher construction costs expected from Veolia; If secondary networks would be considered within the site, Veolia won't have to be involved in the construction process unless a ESCo offer is expected (ESCo's requires adoption internal process to be followed).
 - Another aspect to consider is that the primary network would have to be accessible (24/7) for future maintenance and operations - this is in the case of pipes being installed above ground as presented on the east connection; It is feasible but we need to evaluate the use of the space and how to access it and what disturbance we would cause if there was a leak (leads to liabilities);

Let me know if you need further feedback. My colleague Kieran could provide a ball-park figure for the construction costs even if it is PC sum at this stage.

Kindest Regards,

Joao Sousa CEng MICE
 Head of Heat Network Development
 United Kingdom

e. joao.sousa@veolia.com
 m. +44 (0)79 2075 7242
 t. +44 (0)20 3567 6148
 Veolia UK, Landmann Way, Deptford, LONDON SE14 5RS
www.veolia.co.uk

On Tue, 8 Apr 2025 at 13:01, Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com> wrote:

Hi Joao,

As a follow up on the below query, we would like further confirmation whether the site heat demand can be by the heat network. Attached the updated District Heating connection enquire based on the latest scheme data.

Also, please confirm that it is accepted to have 3 connections to the site as the development is broken down into 3 energy centres providing heating to Phase 1 and 2 of the projects (phase 2 broken down into 2 energy centres). The interface with heat network will be through heat exchangers located in each energy centre to bring the temperature to the operational temperatures within the local network of each phase. Below is schematic of the energy centres and connection routes to the heat network supply.



Your prompt response is appreciated.

Regards,

Mo

Mohamed Mekkawy MSc in CFD, LEED AP® BD+C WELL AP, BREEAM Assessor, CIBSE LCC LCEA ASHRAE CPD BEMP HBDI
Senior Associate | Building Physics Engineer
mobile: +44 7394 570 490

From: Sousa, João <joao.sousa@veolia.com>
Sent: 11 March 2025 17:42
To: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Cc: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

Dear Mohamed,

Thank you for contacting me and for your continued interest in a DH connection.

Regarding the connection, it would most likely be established at Queens Road, as part of our extension to Cossall Estate. Due to the lack of information on the specific connection requirements, it is challenging to provide an accurate estimate of the capital cost at this stage. However, considering a potential connection length of approximately 370m, we estimate that capital costs could be in the region of £2 million, plus the additional costs for on-site connections and plant room equipment.

While our project has experienced some delays, we anticipate that Phase 1 construction will be completed by Summer 2025, with Phase 2 expected to be finalised by the end of 2026.

Please note that our system operates at a higher temperature than typically utilised in new buildings; however, we can accommodate adjustments to suit your specific requirements. Our current operating temperature is above 95°C. The preferred route for the connection remains unchanged.

I hope this information is helpful. Please let me know if you have any further questions.



Kindest Regards,

Joao Sousa CEng MICE
Head of Heat Network Development
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
Veolia UK, Landmann Way, Deptford, LONDON SE14 5RS
www.veolia.co.uk

<https://outlook.office.com/mail/id/AAQkADA4ZGQwNzMzLTE5NTYINDYzOS05NmVhLTc0MjgyMmJkYT5YgAQAG1oGQ%2FzX25AtT3GbNukJ5o%3D?nativeVersion=1.2025.219.400>

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

On Tue, 11 Mar 2025 at 17:14, Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com> wrote:

Hi Joao,

It was great to talk you over phone. As discussed, below is the previous correspondence history on Aylsham centre development.

We would like to have updated information regarding the feasibility of SELCHP heat network connection to the site

The information required will be same as previously provided mainly regarding the potential/preferred network route and access to the site, expected high level costs to connect to the site, timelines of such connection in line with the current network expansion plans, updates on carbon factors of SELCHP if any , flow temperatures.

Please let me know if any information from my end.

Looking forward to hearing from you.

Regards,
Mo

Mohamed Mekkawy MSc in CFD, LEED AP® BD+C WELL AP, BREEAM Assessor, CIBSE LCC LCEA ASHRAE CPD BEMP HBDP OCDEA AMIOA
Senior Associate | Building Physics Engineer
office: +44 207 401 8382
mobile: +44 7394 570 490
Mohamed.Mekkawy@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers



From: Mohamed Mekkawy
Sent: 10 March 2025 14:30
To: Sousa, João <joao.sousa@veolia.com>; enquiries@selchp.com
Cc: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi,

Just following up on the below email trail from 2022 regarding feasibility of connecting SELCH to Aylesham centre project and the timeline expected for this. Could you please provide updated information regarding this based on the latest plans and developments to update our energy strategy accordingly.

Looking forward to hearing from you.

Regards,
Mo

From: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Sent: 10 August 2022 11:51
To: Sousa, João <joao.sousa@veolia.com>
Cc: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

Thanks again for your assistance thus far.

My responses to your statements:

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEX substations which could be £80k each (turn-key solution from Danfoss).

Is this quotation at current or projected market rate? You mention PHEX substations, would Veolia take ownership of the Substations located within our site? I am anticipating 2 PHEX plantrooms, 1 per phase. Are you able to give me an indication on plantroom space requirements for 1000 residential units across 2 phases?

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

Yes I think this would be a good idea. I am in the process of writing a design note to the client to review the various options, so any further information you could provide would be helpful. Looking to issue it early next week.

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

It sounds as though this is a very promising option, as long as it is feasible and the client is on board, then Veolia would be happy to proceed with the strategy?

Many Thanks

https://outlook.office.com/mail/id/AAQkADA4ZGQwNmZLT5NTYNDYzOS05NmVhLTc0MjgyMmJkYTtY5YgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1.2025.219.400

2/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers



From: Sousa, João <joao.sousa@veolia.com>
Sent: 13 July 2022 15:34
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Cc: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Heat is being generated to the DH by the recovery of waste heat used in the process of electricity production. The fuel to produce the steam to generate electricity is residential waste (black bag). You will understand the process through the youtube video [here](#).

The SELCHP plant is constantly being upgraded either through some improvement projects to innovate the plant and technology or even following a defined planned preventive maintenance.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e, joao.sousa@veolia.com
m, +44 (0)79 2075 7242
t, +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd, Landmann Way, Deptford, LONDON SE14 5RS
www.selchp.com www.veolia.co.uk

On Wed, 13 Jul 2022 at 14:58, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Good Afternoon Joao,

Hope you are well.
Thank you again for the information.

I was wondering if you could tell us how the heat is being generated?
And whether the plant will be upgraded in the future?

Many Thanks
Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers



From: Sousa, João <joao.sousa@veolia.com>
Sent: 23 May 2022 15:52
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

https://outlook.office.com/mail/id/AAQkADA4ZGQwNmZLT5NTYNDYzOS05NmVhLTc0MjgyMmJkYTtY5YgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1.2025.219.400

3/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook


This email originated from outside your organization.

[CAUTION: External]

Hi Henry

A connection most likely would be viable as we plan to expand to a location close to your project (Woods Rd and Cossall Park). We would have to conduct feasibility studies to determine where to install pipes and by determining how much it would cost, establish the viability of the connection. You could then compare it to your counterfactual.

I would see the following potential route between the connection point and Aylesham Centre.

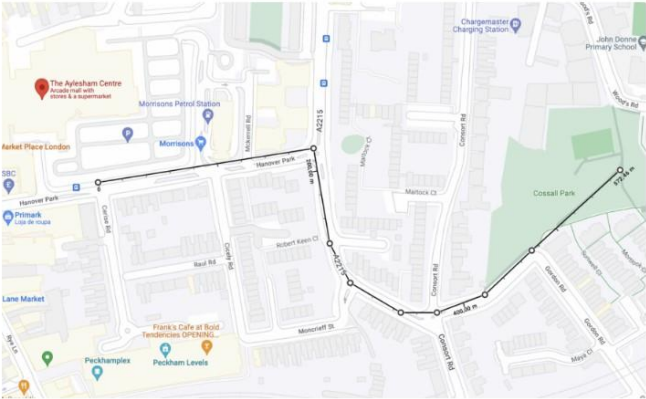

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEX substations which could be £80k each (turn-key solution from Danfoss).

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

I hope this keeps you informed and let me know if you would like to discuss it further.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Mon, 23 May 2022 at 15:09, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Afternoon Joao,

I was wondering if you could provide an update please?

Thanks
Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ

me | engineers

From: Henry Warren-Jones

Sent: 26 April 2022 11:42

To: Sousa, João <joao.sousa@veolia.com>

Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

Thanks for your response, please see attached.

When might we get a response?
We would like to give the client an indication as to whether this is at all feasible.

Many Thanks
Kind Regards

From: Sousa, João <joao.sousa@veolia.com>

Sent: 25 April 2022 12:47

To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>

Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Could you please provide more information by filling out the proforma attached?!
Cheers

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Tue, 19 Apr 2022 at 12:33, Enquiries <enquiries@selchp.com> wrote:

----- Forwarded message -----

From: info@selchp.co.uk <info@selchp.co.uk>

Date: Wed, 13 Apr 2022 at 14:40

Subject: SELCHP - Contact Form Enquiry

To: <maxine.steward@veolia.com>, <claudia.ridler@veolia.com>, <thomas.folliard@selchp.com>

Thank you for your enquiry. We shall contact you shortly.

Name: Henry Warren-Jones
Email: henry.warren-jones@me-engineers.com
Phone: 07804481264
Nature Of Enquiry: Business Enquiry
Contact By: Email
Comments: Good Afternoon SELCHP, We are working on a large residential development in south east London and wish to understand whether we can connect into your district heating network? Could you give me some more information about the network, and some indication as to whether this will be possible. Many Thanks Kind Regards

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.
If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.
Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

https://outlook.office.com/mail/id/AAQKADA4ZGQwNmZLTzE5NTYNDYzOS05NmVhLTc0MjgyMmJkYTY5YgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1.2025.219.400

5/6

319

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (02664833); Veolia Environmental Services Group (UK) Limited (02215767); Veolia Water UK Limited (02127283); Veolia Energy UK Limited (00883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.



District Heating Connection Enquiry

Heat Load Technical Proforma

Client Details

(Insert your details for future communications)

Entity/Company Name

ME Engineers

Lead Contact Name

Henry Warren-Jones

E-mail

ry.warren-jones@Me-engineers.com

Landline

020 7401 8382

Mobile

Project Details & Timeline

(Short description of the project including how many phases, the year each phase is expected to start, etc.)

Location/Address

Aylesham Centre - SE London

Postcode

Planning submitted

☒ Yes ☐ No

Reference No.

Envisaged planning submission date

Number of project phases

Construction date

Starting

Finishing

Heat supply date

01/01/2030

Upload a plan view of the development (e.g. pdf, jpeg):

SELCHP - South East Combine Heat and Power



Heat Load Technical Proforma

Project Built-out Specifications

(please provide a short description of the project)

Large residential development in two phases, including a range of commercial, f&b, gym, retail spaces on ground floor.

Type of Use

(please identify the use of the development and fill all the information to establish a heat profile - Important for proposal)

	No. Units	Area (m2)	Demand (kWh)	Base Load (kW)	Peak Load (kW)	Temperature F&R (°C)
Residential	897.0	60,453.0	2,242,500.0	3,140.0	4,485.0	
Commercial		8,791.6	286,050.0	400.5	572.1	
Offices						
Hotel						
School						

Proposal Request

(tick the boxes you want to include)

☒ Yes

☐ No

Include:

☐ ESCo

☐ Design

☐ Secondary systems

☐ Heat plant O&M

☐ HIU Supply&Install

☐ Billing&Metering

Comments

(please provide any further details to assist you - E.g. Limit date to submit an answer, meeting request or any additional information required to support your energy strategy)

Can the development connect into the district heating network, can you please confirm feasibility and strategy to work with developer to connect to the local sitewide Heat network?

SELCHP - South East Combine Heat and Power

From: Sousa, João <joao.sousa@veolia.com>
Sent: 11 March 2025 17:42
To: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Cc: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

Dear Mohamed,

Thank you for contacting me and for your continued interest in a DH connection.

Regarding the connection, it would most likely be established at Queens Road, as part of our extension to Cossall Estate. Due to the lack of information on the specific connection requirements, it is challenging to provide an accurate estimate of the capital cost at this stage. However, considering a potential connection length of approximately 370m, we estimate that capital costs could be in the region of £2 million, plus the additional costs for on-site connections and plant room equipment.

While our project has experienced some delays, we anticipate that Phase 1 construction will be completed by Summer 2025, with Phase 2 expected to be finalised by the end of 2026.

Regarding the SELCHP carbon footprint, it is expected to align with the recommendations outlined in SAP10.2 - Waste Energy, specifically 0.015kgCO2/kWh.

Please note that our system operates at a higher temperature than typically utilised in new buildings; however, we can accommodate adjustments to suit your specific requirements. Our current operating temperature is above 95°C. The preferred route for the connection remains unchanged.

I hope this information is helpful. Please let me know if you have any further questions.



Kindest Regards,

Joao Sousa CEng MICE
Head of Heat Network Development
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
Veolia UK, Landmann Way, Deptford, LONDON SE14 5RS
www.veolia.co.uk

<https://outlook.office.com/mail/id/AAQkADA4ZGQwNmZLTzE5NTYwNDYzOS05NmVhLTc0MjgyMmJkYTY5YgAQAG1oGQ%2FzX25AtT3GbNukJ5o%3D?nativeVersion=1,2025.219,400>

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

On Tue, 11 Mar 2025 at 17:14, Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com> wrote:

Hi Joao,

It was great to talk you over phone. As discussed, below is the previous correspondence history on Aylsham centre development.

We would like to have updated information regarding the feasibility of SELCHP heat network connection to the site

The information required will be same as previously provided mainly regarding the potential/preferred network route and access to the site, expected high level costs to connect to the site, timelines of such connection in line with the current network expansion plans, updates on carbon factors of SELCHP if any , flow temperatures.

Please let me know if any information from my end.

Looking forward to hearing from you.

Regards,
Mo

Mohamed Mekkawy MSc in CFD, LEED AP® BD+C WELL AP, BREEAM Assessor, CIBSE LCC LCEA ASHRAE CPD BEMP HBDP OCDEA AMIOA
Senior Associate | Building Physics Engineer

office: +44 207 401 8382
mobile: +44 7394 570 490

Mohamed.Mekkawy@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ

me | engineers



From: Mohamed Mekkawy
Sent: 10 March 2025 14:30
To: Sousa, João <joao.sousa@veolia.com>; enquiries@selchp.com
Cc: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi,

Just following up on the below email trail from 2022 regarding feasibility of connecting SELCH to Aylesham centre project and the timeline expected for this. Could you please provide updated information regarding this based on the latest plans and developments to update our energy strategy accordingly.

Looking forward to hearing from you.

Regards,
Mo

From: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Sent: 10 August 2022 11:51
To: Sousa, João <joao.sousa@veolia.com>
Cc: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

Thanks again for your assistance thus far.

My responses to your statements:

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEX substations which could be £80k each (turn-key solution from Danfoss).

Is this quotation at current or projected market rate? You mention PHEX substations, would Veolia take ownership of the Substations located within our site? I am anticipating 2 PHEX plantrooms, 1 per phase. Are you able to give me an indication on plantroom space requirements for 1000 residential units across 2 phases?

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

Yes I think this would be a good idea. I am in the process of writing a design note to the client to review the various options, so any further information you could provide would be helpful. Looking to issue it early next week,

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

It sounds as though this is a very promising option, as long as it is feasible and the client is on board, then Veolia would be happy to proceed with the strategy?

Many Thanks

https://outlook.office.com/mail/id/AAQkADA4ZGQwNmZLT5NTYNDYzOS05NmVhLTc0MjgyMmJkYTY5YgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1,2025.219,400

2/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers



From: Sousa, João <joao.sousa@veolia.com>
Sent: 13 July 2022 15:34
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Cc: Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Heat is being generated to the DH by the recovery of waste heat used in the process of electricity production. The fuel to produce the steam to generate electricity is residential waste (black bag). You will understand the process through the youtube video [here](#).

The SELCHP plant is constantly being upgraded either through some improvement projects to innovate the plant and technology or even following a defined planned preventive maintenance.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e, joao.sousa@veolia.com
m, +44 (0)79 2075 7242
t, +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd, Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Wed, 13 Jul 2022 at 14:58, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Good Afternoon Joao,

Hope you are well.
Thank you again for the information.

I was wondering if you could tell us how the heat is being generated?
And whether the plant will be upgraded in the future?

Many Thanks
Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers



From: Sousa, João <joao.sousa@veolia.com>
Sent: 23 May 2022 15:52
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

https://outlook.office.com/mail/id/AAQkADA4ZGQwNmZLT5NTYNDYzOS05NmVhLTc0MjgyMmJkYTY5YgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1,2025.219,400

3/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook


This email originated from outside your organization.

[CAUTION: External]

Hi Henry

A connection most likely would be viable as we plan to expand to a location close to your project (Woods Rd and Cossall Park). We would have to conduct feasibility studies to determine where to install pipes and by determining how much it would cost, establish the viability of the connection. You could then compare it to your counterfactual.

I would see the following potential route between the connection point and Aylesham Centre.

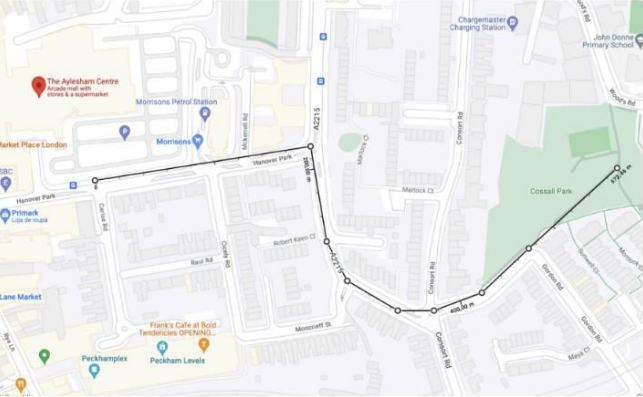

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEX substations which could be £80k each (turn-key solution from Danfoss).

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

I hope this keeps you informed and let me know if you would like to discuss it further.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e, joao.sousa@veolia.com
m, +44 (0)79 2075 7242
t, +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd, Landmann Way, Deptford, LONDON SE14 5RS
www.selchp.com www.veolia.co.uk

On Mon, 23 May 2022 at 15:09, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Afternoon Joao,

I was wondering if you could provide an update please?

Thanks
Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ

me | engineers

From: Henry Warren-Jones
Sent: 26 April 2022 11:42
To: Sousa, Joao <joao.sousa@veolia.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

https://outlook.office.com/mail/id/AAQKADA4ZGQwNzZLTzE5NTYNDYzOS05NmVhLTc0MjgyMmJkYTYSYgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1.2025.219.400

4/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

Thanks for your response, please see attached.

When might we get a response?
We would like to give the client an indication as to whether this is at all feasible.

Many Thanks
Kind Regards

From: Sousa, Joao <joao.sousa@veolia.com>
Sent: 25 April 2022 12:47
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Could you please provide more information by filling out the proforma attached?!
Cheers

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e, joao.sousa@veolia.com
m, +44 (0)79 2075 7242
t, +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd, Landmann Way, Deptford, LONDON SE14 5RS
www.selchp.com www.veolia.co.uk

On Tue, 19 Apr 2022 at 12:33, Enquiries <enquiries@selchp.com> wrote:

----- Forwarded message -----
From: info@selchp.co.uk <info@selchp.co.uk>
Date: Wed, 13 Apr 2022 at 14:40
Subject: SELCHP - Contact Form Enquiry
To: <maxine.steward@veolia.com>, <claudia.ridler@veolia.com>, <thomas.folliard@selchp.com>

Thank you for your enquiry. We shall contact you shortly.

Name: Henry Warren-Jones
Email: henry.warren-jones@me-engineers.com
Phone: 07804481264
Nature Of Enquiry: Business Enquiry
Contact By: Email
Comments: Good Afternoon SELCHP, We are working on a large residential development in south east London and wish to understand whether we can connect into your district heating network? Could you give me some more information about the network, and some indication as to whether this will be possible. Many Thanks Kind Regards

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.
If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.
Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

https://outlook.office.com/mail/id/AAQKADA4ZGQwNzZLTzE5NTYNDYzOS05NmVhLTc0MjgyMmJkYTYSYgAAQAG1oGQ%2FzX25AIT3GbNukJ5o%3D?nativeVersion=1.2025.219.400

5/6

3/13/25, 11:20 AM

Mail - Kate Moore - Outlook

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (02664833); Veolia Environmental Services Group (UK) Limited (02215767); Veolia Water UK Limited (02127283); Veolia Energy UK Limited (00883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

11/29/24, 7:37 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook



Re: SELCHP - Contact Form Enquiry

From Sousa, João <joao.sousa@veolia.com>
Date Wed 7/13/2022 3:34 PM
To Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Cc Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Heat is being generated to the DH by the recovery of waste heat used in the process of electricity production. The fuel to produce the steam to generate electricity is residential waste (black bag). You will understand the process through the youtube video [here](#).
The SELCHP plant is constantly being upgraded either through some improvement projects to innovate the plant and technology or even following a defined planned preventive maintenance.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Wed, 13 Jul 2022 at 14:58, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Good Afternoon Joao,

Hope you are well.

Thank you again for the information.

I was wondering if you could tell us how the heat is being generated?

about:blank?windowId=SecondaryReadingPane4

1/6

11/29/24, 7:37 PM Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

And whether the plant will be upgraded in the future?

Many Thanks

Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207,401,8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ



From: Sousa, João <joao.sousa@veolia.com>
Sent: 23 May 2022 15:52
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.


[CAUTION: External]

Hi Henry

A connection most likely would be viable as we plan to expand to a location close to your project (Woods Rd and Cossall Park). We would have to conduct feasibility studies to determine where to install pipes and by determining how much it would cost, establish the viability of the connection. You could then compare it to your counterfactual.

I would see the following potential route between the connection point and Aylesham Centre.

11/29/24, 7:37 PM Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

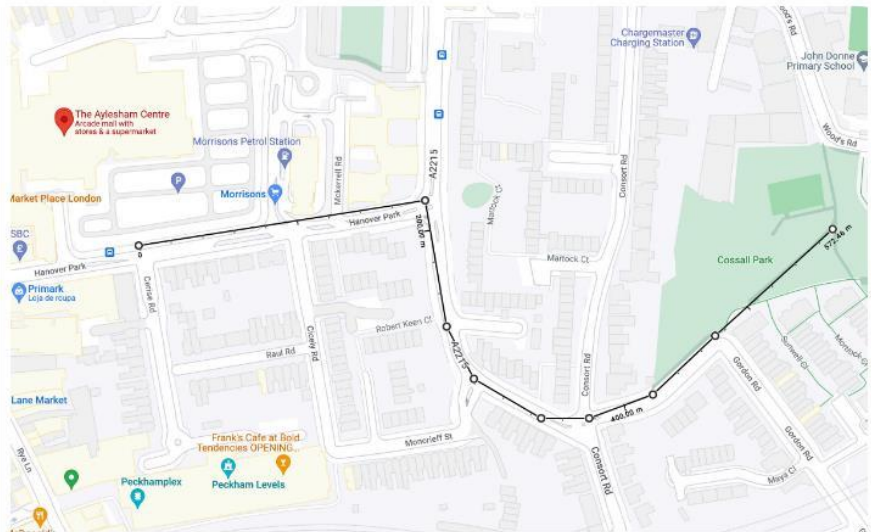

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEX substations which could be £80k each (turn-key solution from Danfoss).

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

I hope this keeps you informed and let me know if you would like to discuss it further.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom
e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS
www.selchp.com www.veolia.co.uk

On Mon, 23 May 2022 at 15:09, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Afternoon Joao,

I was wondering if you could provide an update please?

Thanks

11/29/24, 7:37 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Kind Regards

Henry Warren-Jones

MEng, MSc

Senior Mechanical Engineer

office: +44 207 401 8382

Henry.Warren-Jones@me-engineers.com

Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ

me | engineers

From: Henry Warren-Jones

Sent: 26 April 2022 11:42

To: Sousa, João <joao.sousa@veolia.com>

Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

Thanks for your response, please see attached.

When might we get a response?

We would like to give the client an indication as to whether this is at all feasible.

Many Thanks

Kind Regards

From: Sousa, João <joao.sousa@veolia.com>

Sent: 25 April 2022 12:47

To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>

Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Could you please provide more information by filling out the proforma attached?!

about:blank?windowId=SecondaryReadingPane4

4/6

11/29/24, 7:37 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Cheers

Kindest Regards,

Joao Sousa

CEng MICE

District Heating Contract Manager

United Kingdom

e. joao.sousa@veolia.com

m. +44 (0)79 2075 7242

t. +44 (0)20 3567 6148

SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Tue, 19 Apr 2022 at 12:33, Enquiries <enquiries@selchp.com> wrote:

----- Forwarded message -----

From: info@selchp.co.uk <info@selchp.co.uk>

Date: Wed, 13 Apr 2022 at 14:40

Subject: SELCHP - Contact Form Enquiry

To: <maxine.steward@veolia.com>, <claudia.ridler@veolia.com>, <thomas.folliard@selchp.com>

Thank you for your enquiry. We shall contact you shortly.

Name: Henry Warren-Jones

Email: henry.warren-jones@me-engineers.com

Phone: 07804481264

Nature Of Enquiry: Business Enquiry

Contact By: Email

Comments: Good Afternoon SELCHP, We are working on a large residential development in south east London and wish to understand whether we can connect into your district heating network? Could you give me some more information about the network, and some indication as to whether this will be possible. Many Thanks Kind Regards

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):

Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);

Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising

about:blank?windowId=SecondaryReadingPane4

5/6

326

11/29/24, 7:37 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.


The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.
If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.
Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer
on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):
Veolia UK Limited (2664833);
Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210
Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.
If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.
Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

11/29/24, 7:35 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook



Re: SELCHP - Contact Form Enquiry

From Sousa, João <joao.sousa@veolia.com>
Date Mon 5/23/2022 3:52 PM
To Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>

2 attachments (866 KB)
District Heating Connection Enquiry.pdf; Scope.png;


This email originated from outside your organization.

[CAUTION: External]

Hi Henry

A connection most likely would be viable as we plan to expand to a location close to your project (Woods Rd and Cossall Park). We would have to conduct feasibility studies to determine where to install pipes and by determining how much it would cost, establish the viability of the connection. You could then compare it to your counterfactual.

I would see the following potential route between the connection point and Aylesham Centre.

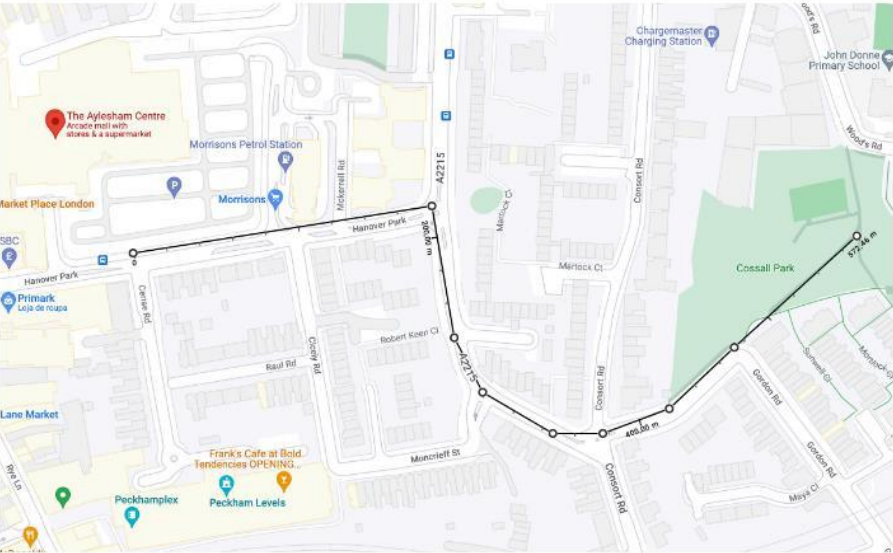

11/29/24, 7:35 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEx substations which could be £80k each (turn-key solution from Danfoss).

If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).

After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.

I hope this keeps you informed and let me know if you would like to discuss it further.

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom

e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Mon, 23 May 2022 at 15:09, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Afternoon Joao,

I was wondering if you could provide an update please?

Thanks

Kind Regards

Henry Warren-Jones MEng, MSc
Senior Mechanical Engineer
office: +44 207 401 8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ

me | engineers

From: Henry Warren-Jones
Sent: 26 April 2022 11:42
To: Sousa, João <joao.sousa@veolia.com>
Subject: RE: SELCHP - Contact Form Enquiry

Hi Joao,

about:blank?windowId=SecondaryReadingPane2

11/29/24, 7:35 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Thanks for your response, please see attached.

When might we get a response?

We would like to give the client an indication as to whether this is at all feasible.

Many Thanks

Kind Regards

From: Sousa, João <joao.sousa@veolia.com>
Sent: 25 April 2022 12:47
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,

Could you please provide more information by filling out the proforma attached?!

Cheers

Kindest Regards,

Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom
e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Tue, 19 Apr 2022 at 12:33, Enquiries <enquiries@selchp.com> wrote:

----- Forwarded message -----

From: info@selchp.co.uk <info@selchp.co.uk>
Date: Wed, 13 Apr 2022 at 14:40
Subject: SELCHP - Contact Form Enquiry
To: <maxine.steward@veolia.com>, <claudia.ridder@veolia.com>, <thomas.folliard@selchp.com>

Thank you for your enquiry. We shall contact you shortly.

Name: Henry Warren-Jones

about:blank?windowId=SecondaryReadingPane2

11/29/24, 7:35 PM

Re: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Email: henry.warren-jones@me-engineers.com

Phone: 07804481264

Nature Of Enquiry: Business Enquiry

Contact By: Email

Comments: Good Afternoon SELCHP, We are working on a large residential development in south east London and wish to understand whether we can connect into your district heating network? Could you give me some more information about the network, and some indication as to whether this will be possible. Many Thanks Kind Regards

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):

Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);

Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer

on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):

Veolia UK Limited (2664833);

Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);

Registered office 210

Pentonville Road, London N1 9JY.

The information in this email and any associated

files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please

note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments

are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is

accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

about:blank?windowId=SecondaryReadingPane2

4/4

11/29/24, 7:36 PM

RE: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

 Outlook

RE: SELCHP - Contact Form Enquiry

From Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>

Date Wed 7/13/2022 2:58 PM

To Sousa, João <joao.sousa@veolia.com>

Cc Mohamed Mekkawy <Mohamed.Mekkawy@me-engineers.com>

11/29/24, 7:36 PM

RE: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

11/29/24, 7:36 PM

RE: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Good Afternoon Joao,
Hope you are well.
Thank you again for the information.
I was wondering if you could tell us how the heat is being generated?
And whether the plant will be upgraded in the future?
Many Thanks
Kind Regards

Henry Warren-JonesMEng, MSc
Senior Mechanical Engineer
office: +44 207.401.8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ
me | engineers




From: Sousa, João <joao.sousa@veolia.com>
Sent: 23 May 2022 15:52
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry
A connection most likely would be viable as we plan to expand to a location close to your project (Woods Rd and Cossall Park). We would have to conduct feasibility studies to determine where to install pipes and by determining how much it would cost, establish the viability of the connection. You could then compare it to your counterfactual.
I would see the following potential route between the connection point and Aylesham Centre.

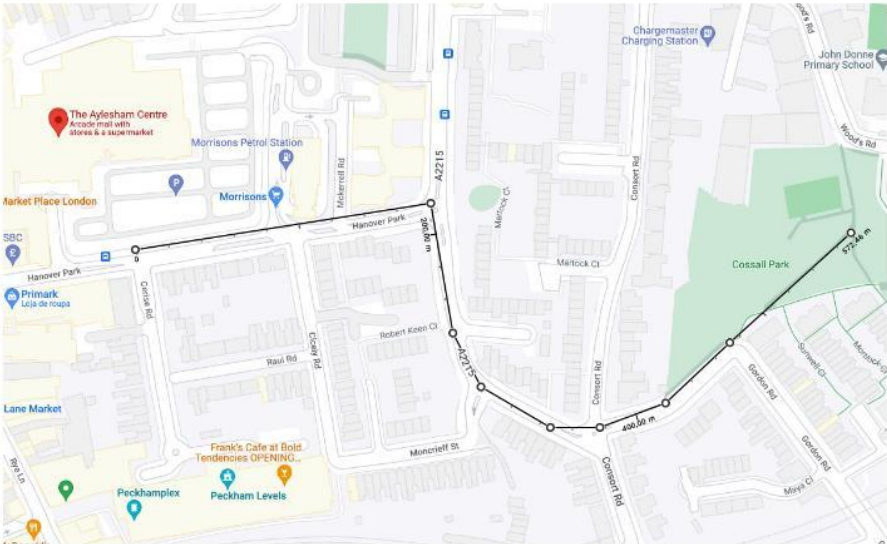

As a rule of thumb, I could estimate a ~£1.6M cost for civils and pipe installation plus PHEx substations which could be £80k each (turn-key solution from Danfoss).
If you consider it's worth discussing, I would suggest scheduling a meeting to discuss feasibility studies. We could start with a RIBA stage 2 and develop to a more advanced design at a later stage as you progress with your project (see high-level scope attached).
After feasibility studies the connection is deemed to be feasible and viable, we will need formal commitment from your client for the connection. This is because we will have to invest in the pipes upstream, with a decision Q1/Q2 next 2023. We should start construction soon after.
I hope this keeps you informed and let me know if you would like to discuss it further.
Kindest Regards,
Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom
e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk
On Mon, 23 May 2022 at 15:09, Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com> wrote:

Afternoon Joao,
I was wondering if you could provide an update please?
Thanks
Kind Regards

about:blank?windowId=SecondaryReadingPane3

3/6

about:blank?windowId=SecondaryReadingPane3

2/6

11/29/24, 7:36 PM

RE: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

Henry Warren-JonesMEng, MSc
Senior Mechanical Engineer
office: +44 207.401.8382
Henry.Warren-Jones@me-engineers.com
Europoint Centre, 2nd Floor, 5-11 Lavington Street, London SE1 0NZ


From: Henry Warren-Jones
Sent: 26 April 2022 11:42
To: Sousa, João <joao.sousa@veolia.com>
Subject: RE: SELCHP - Contact Form Enquiry
Hi Joao,
Thanks for your response, please see attached.
When might we get a response?
We would like to give the client an indication as to whether this is at all feasible.
Many Thanks
Kind Regards

From: Sousa, João <joao.sousa@veolia.com>
Sent: 25 April 2022 12:47
To: Henry Warren-Jones <Henry.Warren-Jones@me-engineers.com>
Subject: Re: SELCHP - Contact Form Enquiry

This email originated from outside your organization.

[CAUTION: External]

Hi Henry,
Could you please provide more information by filling out the proforma attached?!
Cheers
Kindest Regards,
Joao Sousa CEng MICE
District Heating Contract Manager
United Kingdom
e. joao.sousa@veolia.com
m. +44 (0)79 2075 7242
t. +44 (0)20 3567 6148
SELCHP Ltd / Veolia ES SELCHP Ltd , Landmann Way, Deptford, LONDON SE14 5RS

www.selchp.com www.veolia.co.uk

On Tue, 19 Apr 2022 at 12:33, Enquiries <enquiries@selchp.com> wrote:

----- Forwarded message -----
From: info@selchp.co.uk <info@selchp.co.uk>
Date: Wed, 13 Apr 2022 at 14:40
Subject: SELCHP - Contact Form Enquiry

11/29/24, 7:36 PM

RE: SELCHP - Contact Form Enquiry - Kate Moore - Outlook

To: <maxine.steward@veolia.com>, <claudia.ridler@veolia.com>, <thomas.folliard@selchp.com>

Thank you for your enquiry. We shall contact you shortly.

Name: Henry Warren-Jones
Email: henry.warren-jones@me-engineers.com
Phone: 07804481264
Contact By: Email
Comments: Good Afternoon SELCHP, We are working on a large residential development in south east London and wish to understand whether we can connect into your district heating network? Could you give me some more information about the network, and some indication as to whether this will be possible. Many Thanks Kind Regards

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):

Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.

The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

Legal Disclaimer on behalf of the following companies registered in England and Wales under the following numbers (and all subsidiaries and group companies of the same):


Veolia UK Limited (2664833); Veolia Environmental Services (UK) plc (2215767); Veolia Water UK Limited (2127283); Veolia Energy UK plc (883131);
Registered office 210 Pentonville Road, London N1 9JY.


The information in this email and any associated files is confidential and may be legally privileged. It may also contain information that is subject to copyright or constitutes a trade secret. It is intended solely for the named recipient. Access to this email by anyone else is unauthorised.

If you are not the intended recipient, please note that any use, disclosure, copying, distribution of this email or any action taken or omitted to be taken in reliance on it is prohibited.

Warning: Although this email and any attachments are believed to be free from viruses, it is the responsibility of the recipient to ensure that they are virus free. No responsibility is accepted by any of the Veolia group companies for any loss or damage arising in any way from their receipt or opening.

APPENDIX K PV Roof Level Layouts

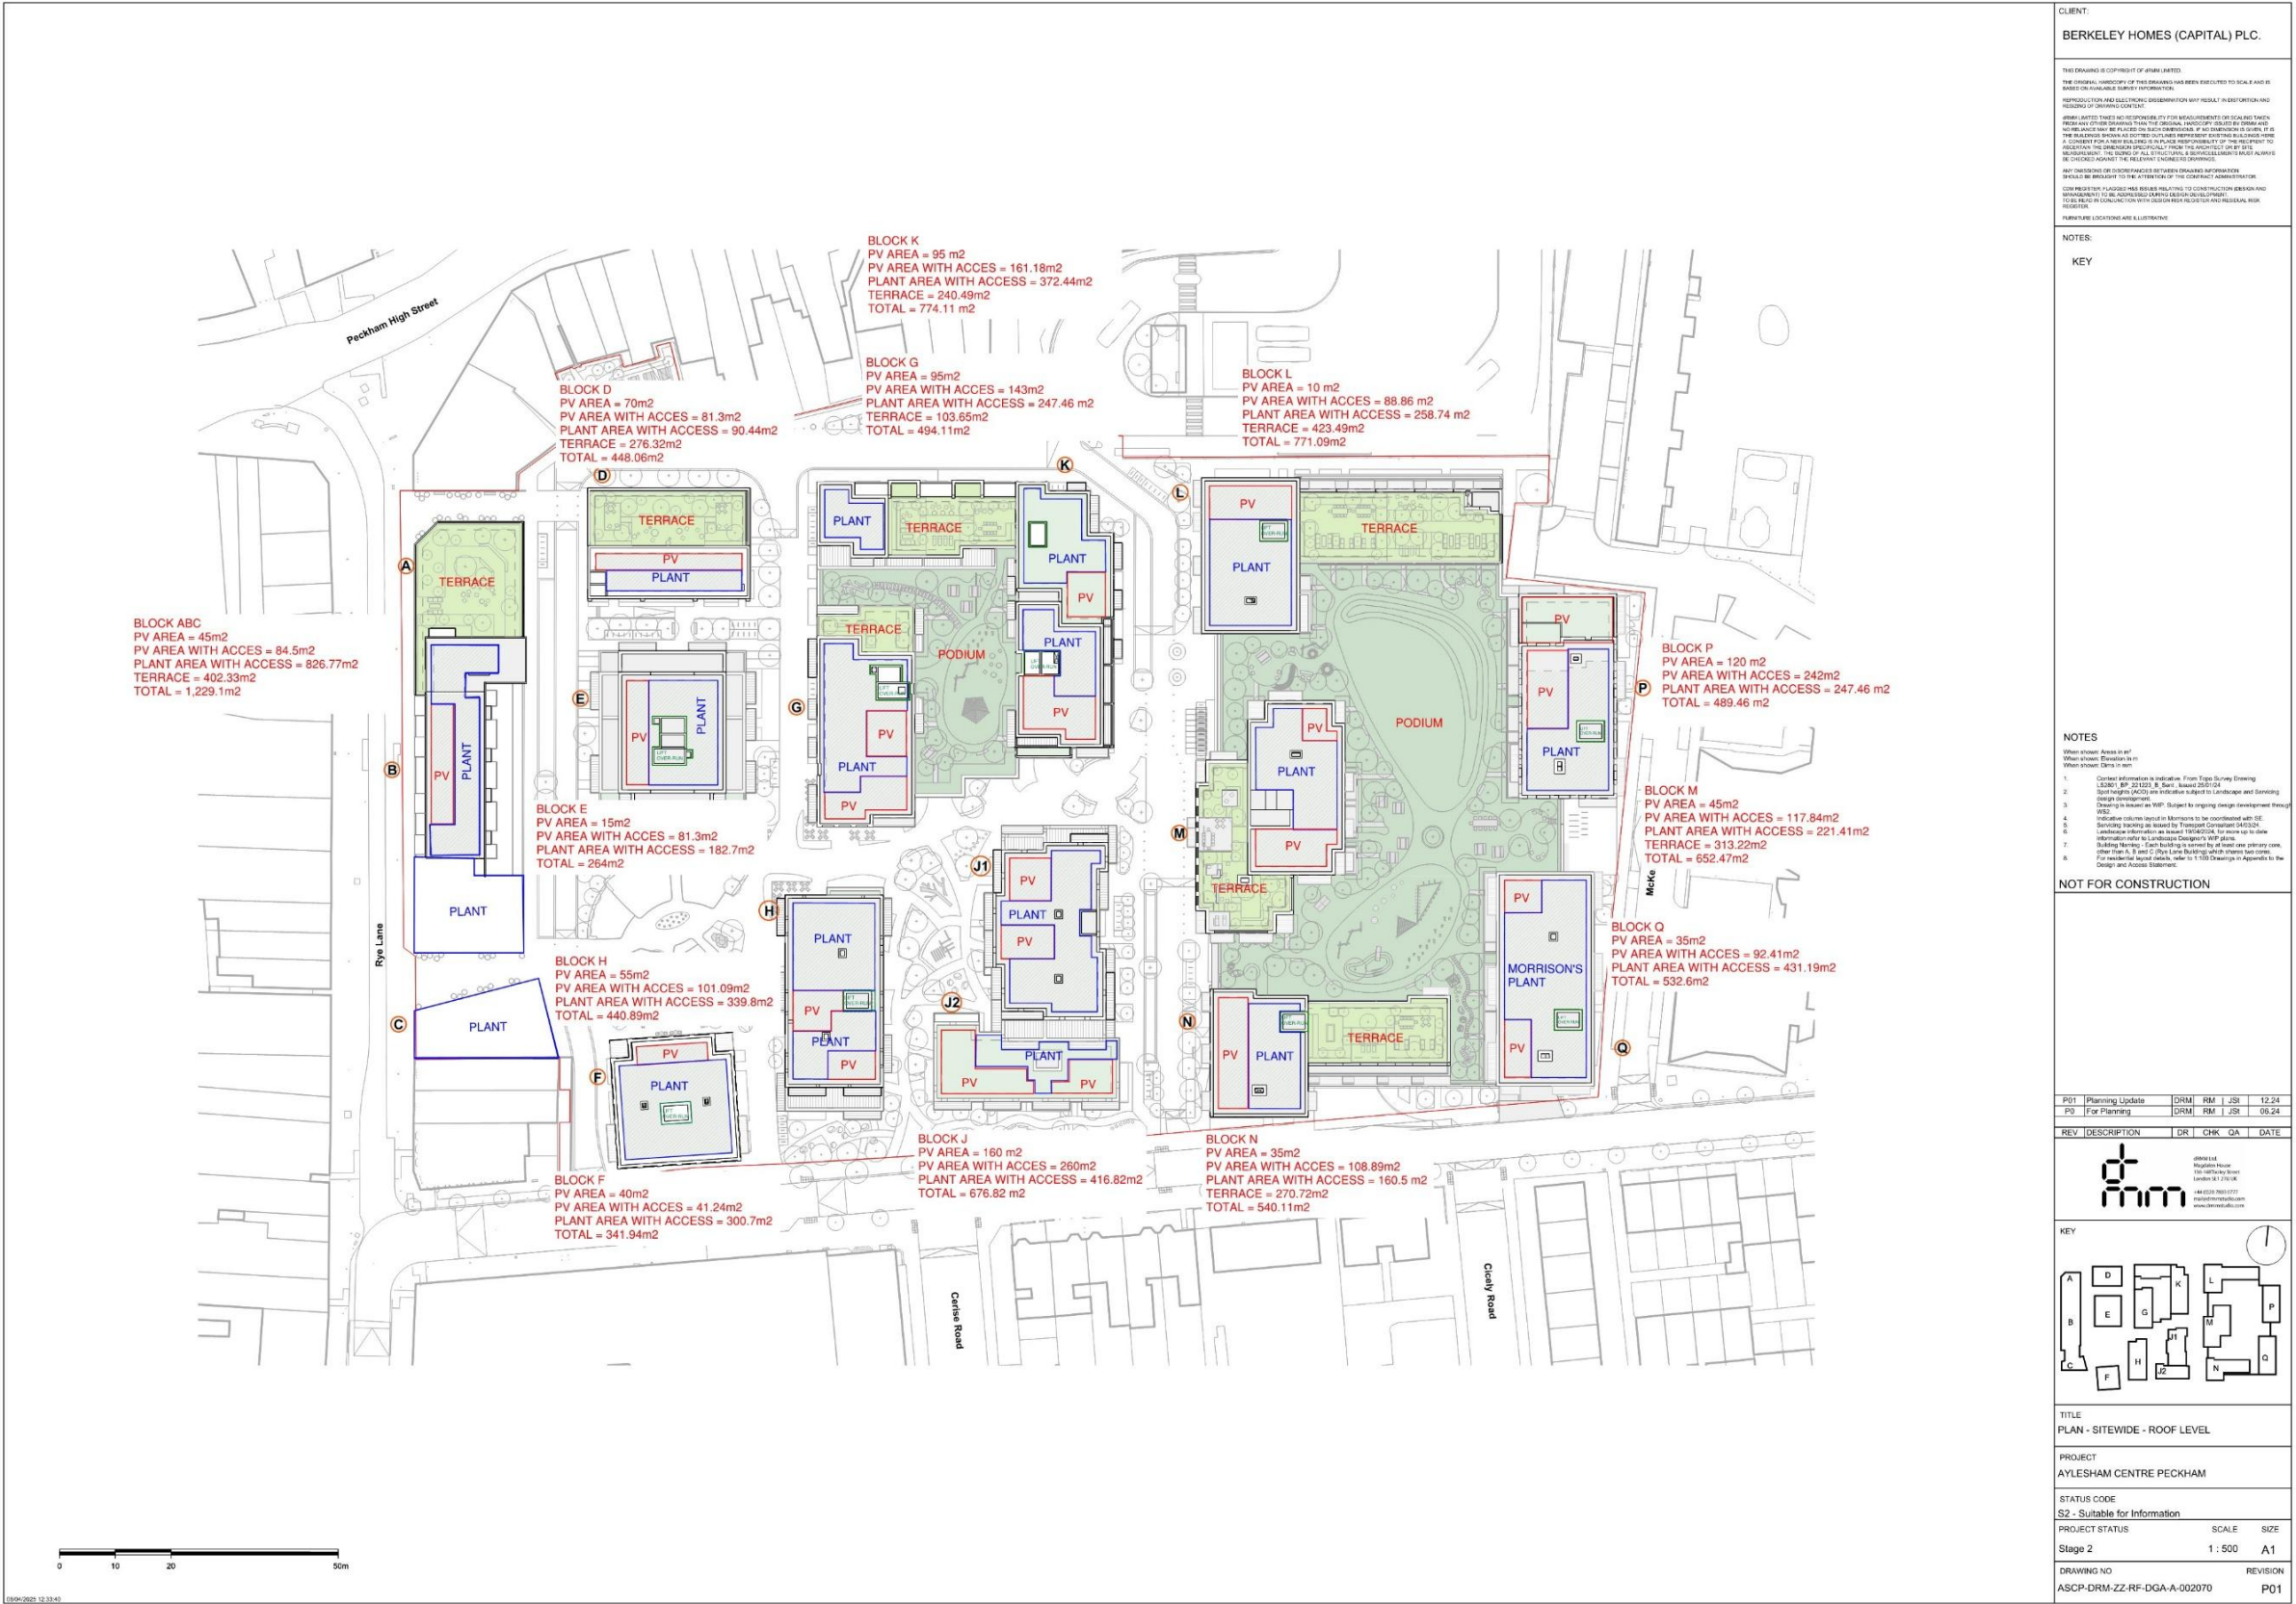

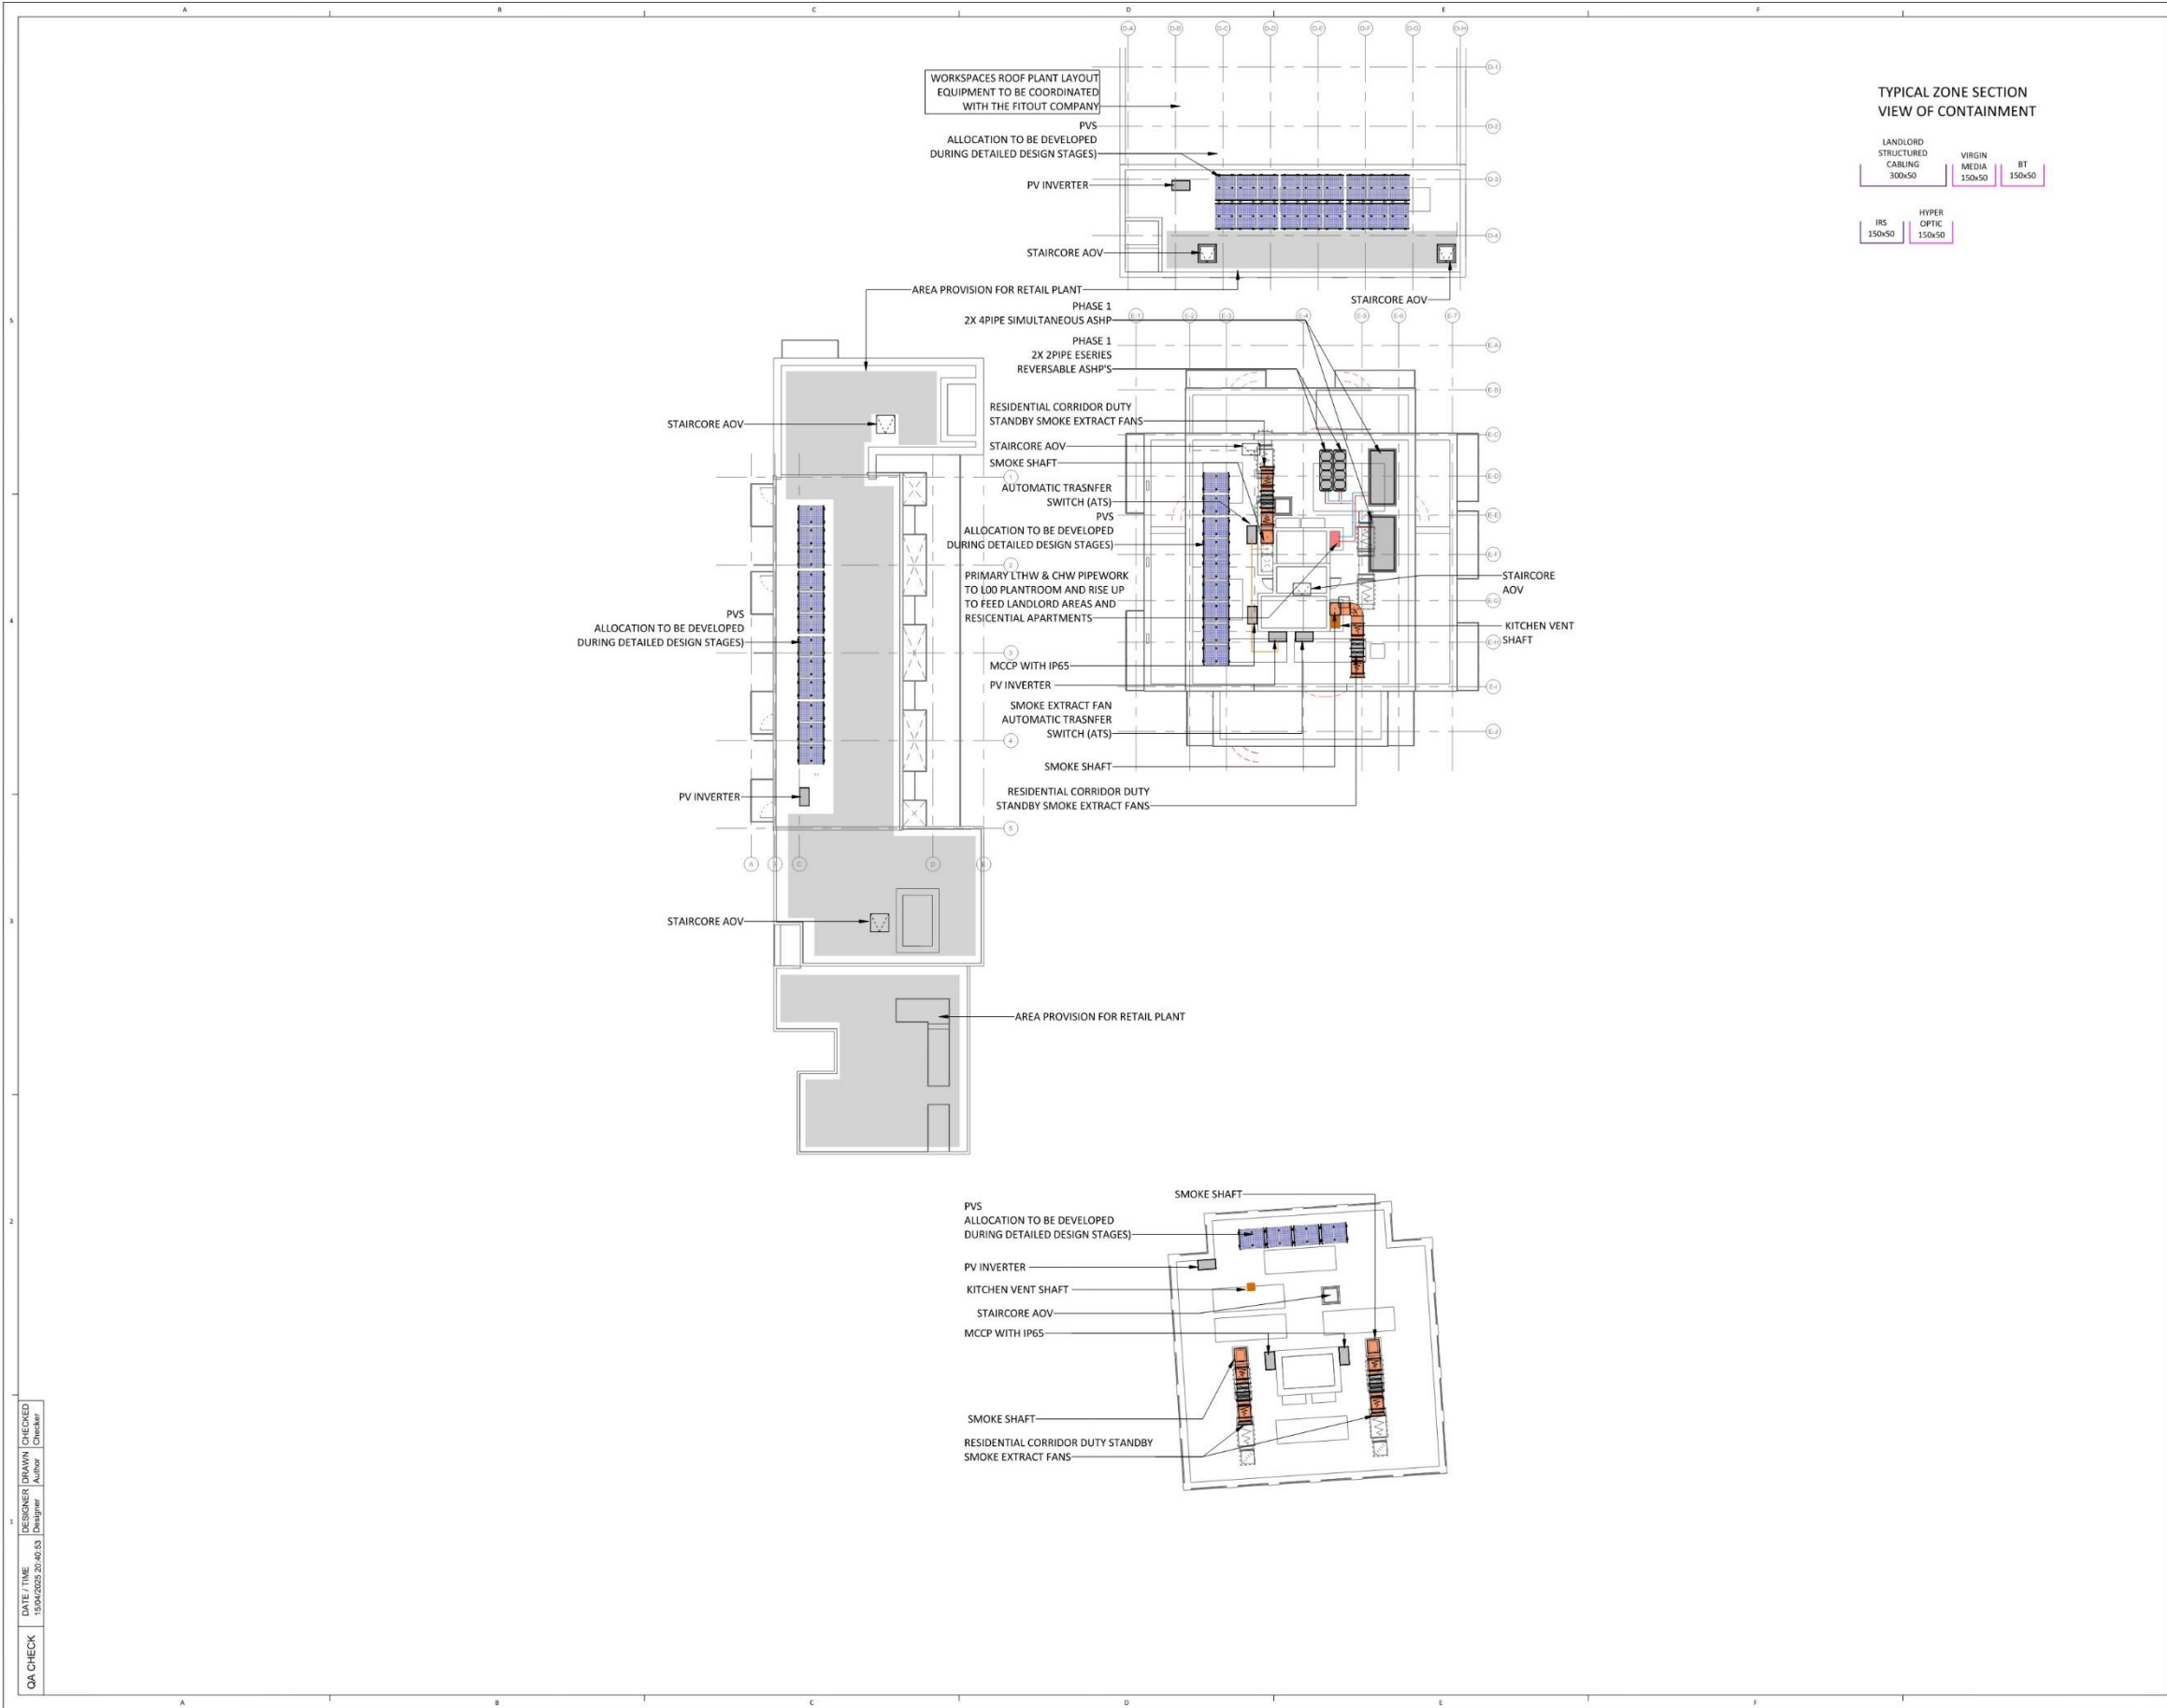

THIS DOCUMENT SHOULD NOT BE RELIED ON OR USED IN ANY CIRCUMSTANCES OTHER THAN THOSE IT WAS ORIGINALLY PREPARED & ME ENGINEERS LTD WERE COMMISSIONED. ME ENGINEERS LTD ACCEPT NO RESPONSIBILITY FOR THIS DOCUMENT USED BY ANY SUB-PARTY OTHER THAN THE PERSON BY WHOM IT WAS COMMISSIONED. © COPYRIGHT

SCALE

LINKS

KEYPLAN

NOTES

PRELIMINARY DRAFT DRAWING FOR INFORMATION. ALL ROUTES, SIZES, DETAILS AND DIMENSIONS ARE INDICATIVE, TO BE DEVELOPED DURING STAGE 3

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT STRUCTURAL, ARCHITECTURAL & CONSULTANTS DRAWINGS.
2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SERVICES SPECIFICATION.
3. DO NOT SCALE THIS DRAWING ALL DIMENSIONS TO BE VERIFIED ON SITE.
4. THIS DRAWING SHALL ONLY BE USED FOR THE SPECIFIC SERVICES INDICATED.
5. FOR SYMBOLS & ABBREVIATIONS REFER TO DRAWING: ASCP-MEE-XX-XX-DDT-Z-001001

MEP SERVICES:

- CHW
- LTHW
- PUBLIC HEALTH
- LANDLORD SERVICES
- SERVICE PROVIDERS
- CONTAINMENT
- INCOMING SERVICES

RISER DETAILS:

- MECHANICAL RISER
- LIFE SAFETY RISER
- COMMS RISER
- ELECTRICAL RISER
- PUBLIC HEALTH RISER
- SMOKE EXTRACT RISER
- MUC CUPBOARD

REV	DATE	DESCRIPTION
P01	05.08.24	STAGE 2 - ISSUED FOR INFORMATION

CLIENT

Berkeley
Designed for life
68 Aile Street
London, E1 8PX

MEP CONSULTANTS

me engineers
Second Floor Euro Centre
5-11 Livingston Street
London SE1 0NZ
T: +44 (0) 207 401 8382
www.me-engineers.com

PROJECT

AYLESHAM CENTRE PECKHAM


TITLE

**PHASE 3
MEP SERVICES
PHASE 2 AYLESHAM - COMBINED
SERVICES ROOF LEVEL MEP LAYOUT**

ME REF	SCALE (A1)	STATUS	REV
22006	As indicated	RIBA 2 CONCEPT DESIGN	P01

DRAWING NUMBER

ASCP-MEE-AY-RF-DGA-Z-002101

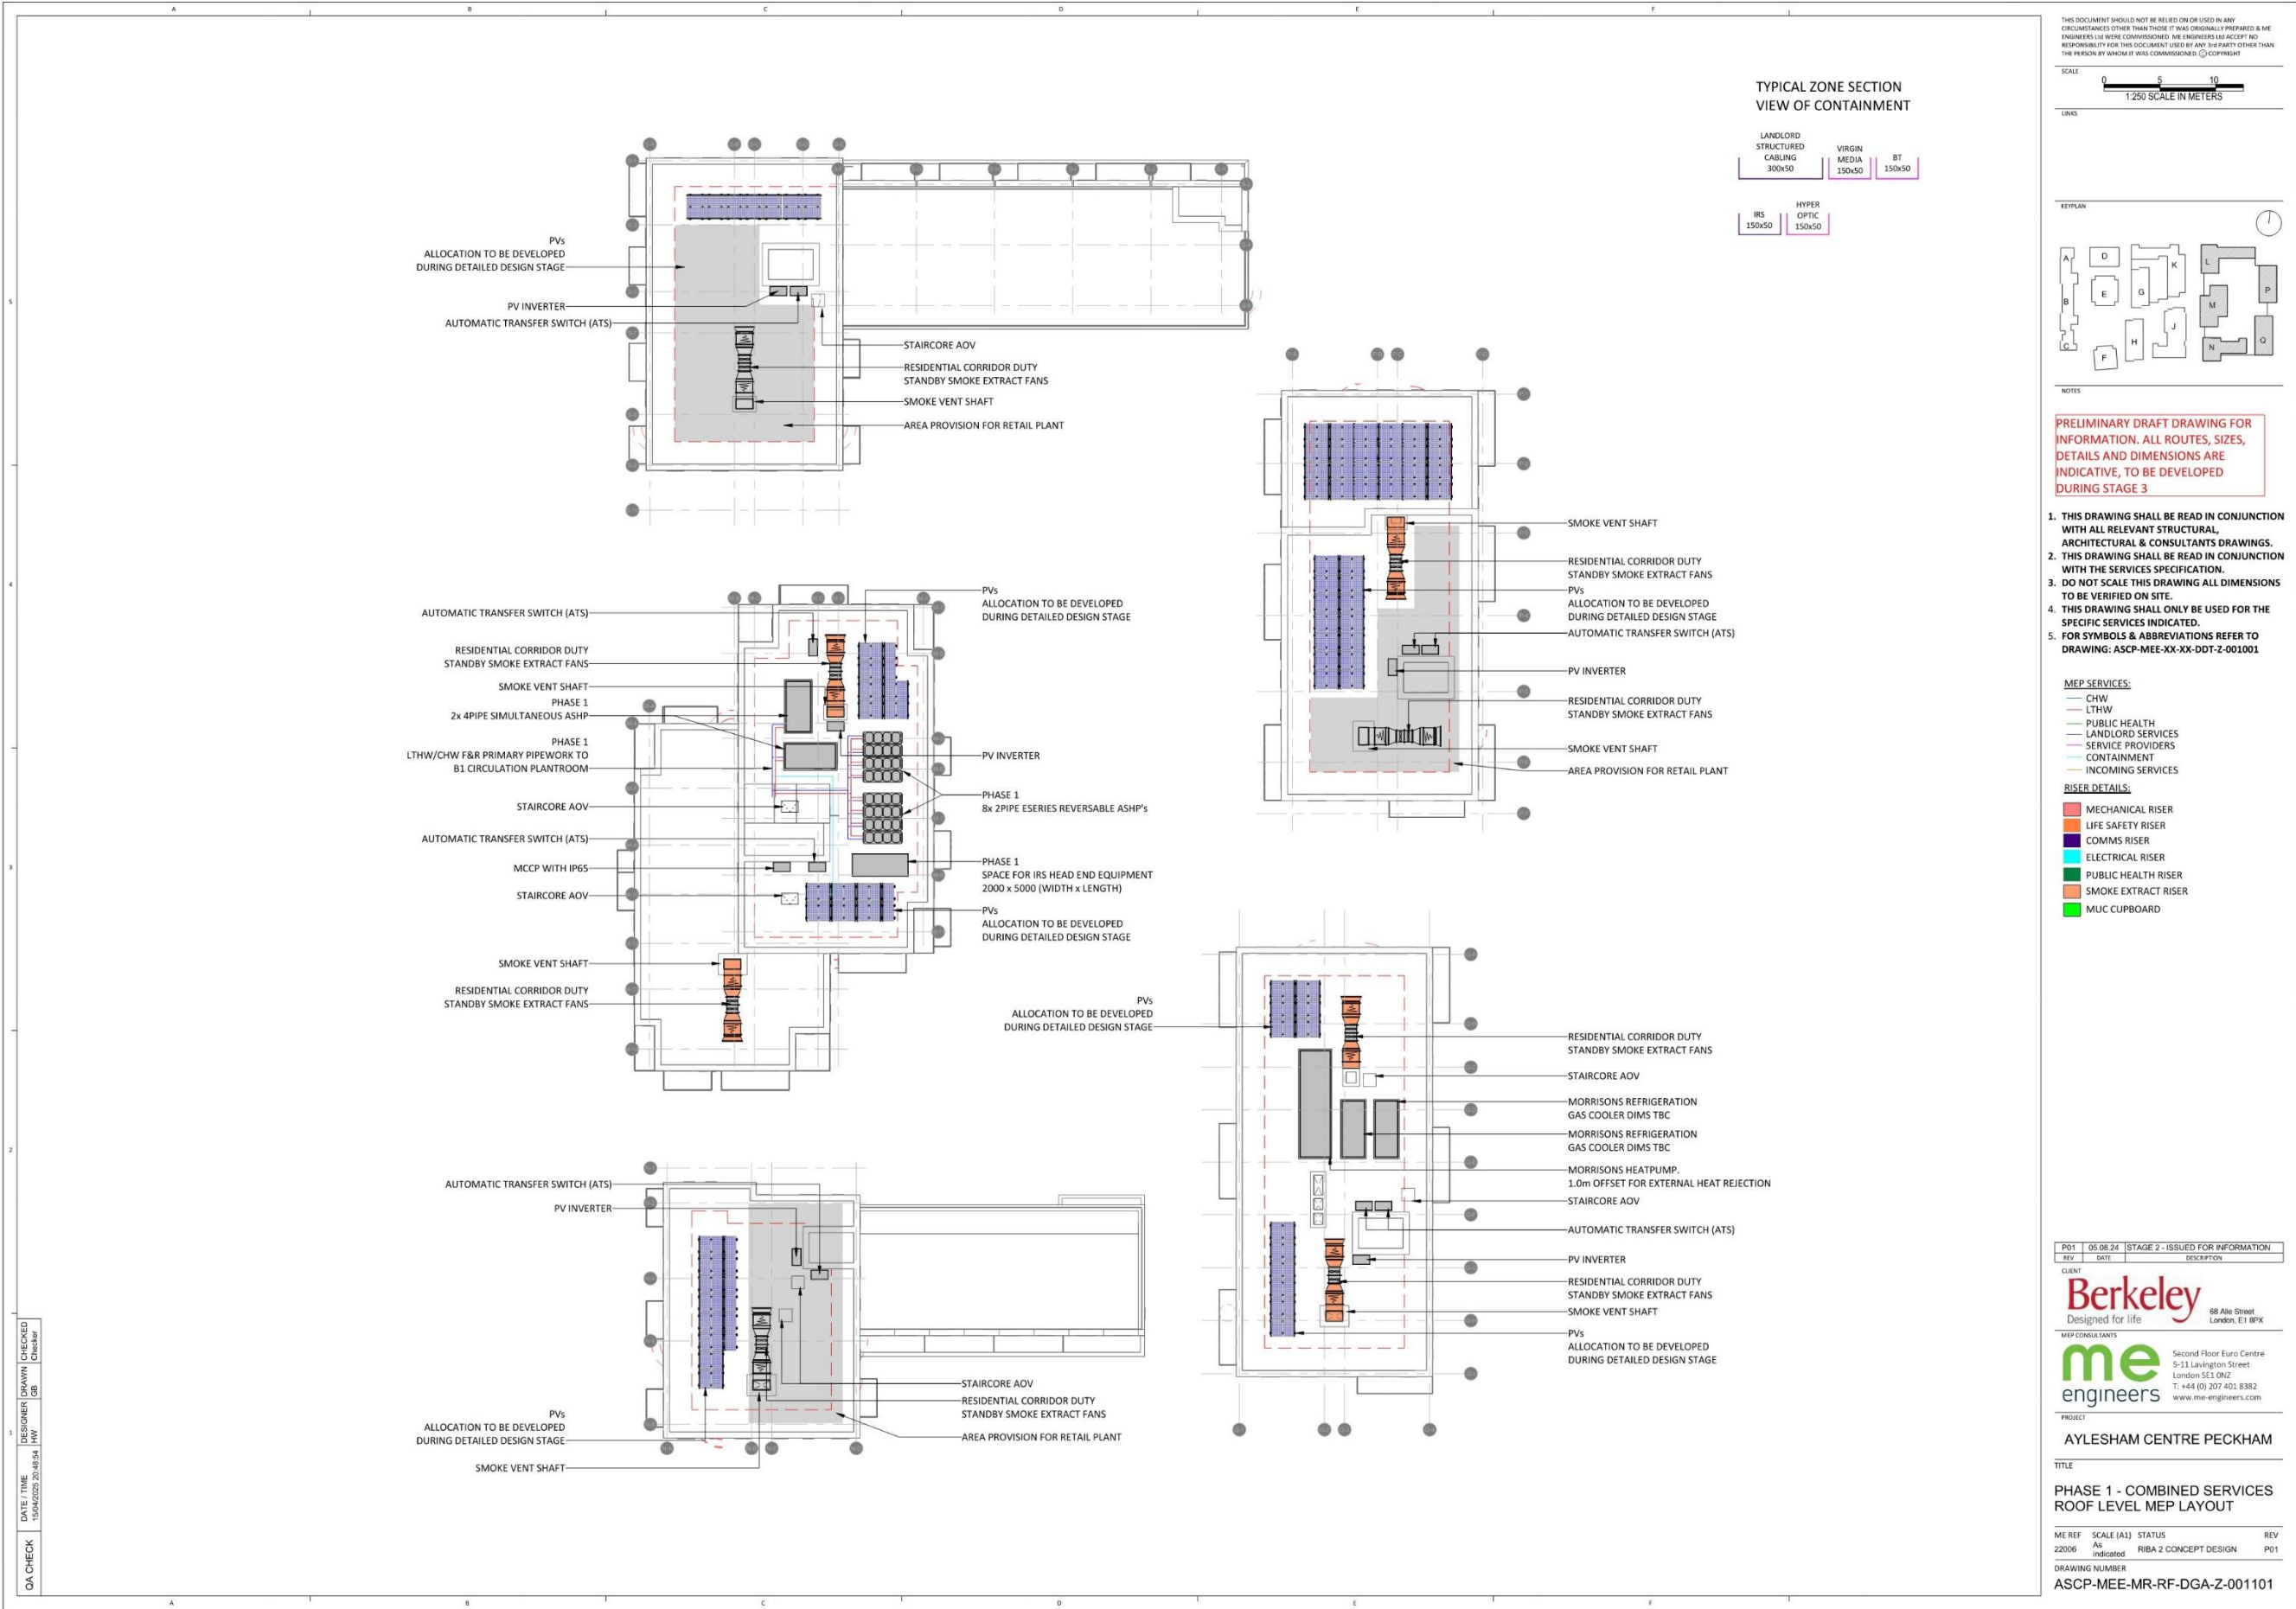



THIS DOCUMENT SHOULD NOT BE RELIED ON OR USED IN ANY CIRCUMSTANCES OTHER THAN THOSE IT WAS ORIGINALLY PREPARED & THE ENGINEERS USE WERE COMMISSIONED. THE ENGINEERS DO NOT ACCEPT ANY RESPONSIBILITY FOR THIS DOCUMENT USED BY ANY 3RD PARTY OTHER THAN THE PERSON BY WHOM IT WAS COMMISSIONED. © COPYRIGHT

SCALE

LINKS

KEEP PLAN

NOTES

PRELIMINARY DRAFT DRAWING FOR INFORMATION. ALL ROUTES, SIZES, DETAILS AND DIMENSIONS ARE INDICATIVE, TO BE DEVELOPED DURING STAGE 3

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT STRUCTURAL, ARCHITECTURAL & CONSULTANTS DRAWINGS.
2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SERVICES SPECIFICATION.
3. DO NOT SCALE THIS DRAWING ALL DIMENSIONS TO BE VERIFIED ON SITE.
4. THIS DRAWING SHALL ONLY BE USED FOR THE SPECIFIC SERVICES INDICATED.
5. FOR SYMBOLS & ABBREVIATIONS REFER TO DRAWING: ASCP-MEE-XX-XX-DDT-2-001001

MEP SERVICES:

- CHW
- LTHW
- PUBLIC HEALTH
- LANDLORD SERVICES
- SERVICE PROVIDERS
- CONTAINMENT
- INCOMING SERVICES

RISER DETAILS:

- MECHANICAL RISER
- LIFE SAFETY RISER
- COMMS RISER
- ELECTRICAL RISER
- PUBLIC HEALTH RISER
- SMOKE EXTRACT RISER
- MUC CUPBOARD

REV	DATE	DESCRIPTION
P01	05.08.24	STAGE 2 - ISSUED FOR INFORMATION

CLIENT

Berkeley
Designed for life
68 Aile Street
London, E1 8PX

MEP CONSULTANTS

me engineers
Second Floor Euro Centre
5-11 Lavington Street
London SE1 0NZ
T: +44 (0) 207 401 8382
www.me-engineers.com

PROJECT

AYLESHAM CENTRE PECKHAM

TITLE

PHASE 2
MEP SERVICES
PHASE 2 PECKHAM YARD -
COMBINED SERVICES ROOF LEVEL

MEP LAYOUT STATUS REV
22006 1:250 RIBA 2 CONCEPT DESIGN P01

DRAWING NUMBER

ASCP-MEE-PY-RF-DGA-Z-002101

APPENDIX L Site Wide Energy Centre and Potential Connection to Heat Network


12.77 Option 1



The site plan shows the Aylesham Centre, Peckham, with various buildings and streets. Key features include:

- Streets:** Rye Lane, Peckham High Street, Hanover Park, Cressy Road, McKenral Road.
- Buildings:** Various buildings labeled with letters (A, B, C, D, E, F, G, H, J1, J2, L, M, N, P, Q) and numbers (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100).
- Annotations:**
 - INDICATIVE FUTURE DISTRICT HEATING CONNECTION TBC DH PROVIDER
 - INDICATIVE FUTURE DISTRICT HEATING NETWORK ALONG PECKHAM HIGH STREET TBC DH PROVIDER
 - ENTERS PHASE 1 AND DROPS TO RUN WITHIN BASEMENT LEVEL
 - LOCATED AT BASEMENT LEVEL INDICATED HERE FOR CONTEXT
 - REMEDIAL WORKS TO THE PAVEMENT AND KERB ON HANOVER PARK AND MCKENRAL ROAD OUTSIDE OF THE RED LINE BOUNDARY WILL NEED TO BE AGREED WITH ALL STAKEHOLDERS AND INCURRED AS A SEPARATE COST INCURMENT
- Scale:** 0 10 20 30m
- Legend:**
 - 100P: Ancillary/Part of House
 - 100P: Flexible Retail/Lounge/Commercial/Workspace
 - 200P: Residential Cycle Store
 - 200P: Supermarket
 - 200P: Supermarket Service
 - 200P: YardPlant
 - 200P: Roof Garden (Residential Amenity)
 - 200P: Podium Residential Amenity
 - 200P: Green Roof
 - 200P: Indicative MEP/VP
 - Wheelchair Accessible Home
 - 300mm offset
- Notes:**
 - 1. Context information is illustrative only.
 - 2. Street layout, width and level are indicative and subject to Landscape and Servicing design.
 - 3. Ancillary design is subject to ongoing design development through the planning process.
 - 4. Structure information is illustrative only, for more information refer to the Structural Design Package.
 - 5. Landscaping information is illustrative only, for more information refer to the Landscaping Package.
 - 6. Landscaping information is illustrative only, for more information refer to the Landscaping Package.
 - 7. Landscaping information is illustrative only, for more information refer to the Landscaping Package.
 - 8. For residential layout details, refer to 1:500 Drawings in Appendix to this Design and Access Statement.
 - 9. Where shown, areas are in m2, elevation is m, and units are m.
- NOT FOR CONSTRUCTION**
- Revision Table:**

REV	DESCRIPTION	DR	CHK	QA	DATE
P0	For Planning	DR	M	JSR	06.24
- Logo:** dmm
- Key:** A, B, C, D, E, F, G, H, J1, J2, L, M, N, P, Q
- Title:** TITLE PLAN - SITEWIDE - GROUND FLOOR
- Project:** PROJECT AYLESHAM CENTRE PECKHAM
- Project Status:** PROJECT STATUS PLANNING
- Scale:** SCALE 1:500
- Size:** SIZE A1
- Drawing No:** DRAWING NO. ASCP-DRM-XX-00-DGA-A-020250
- Revision:** REVISION

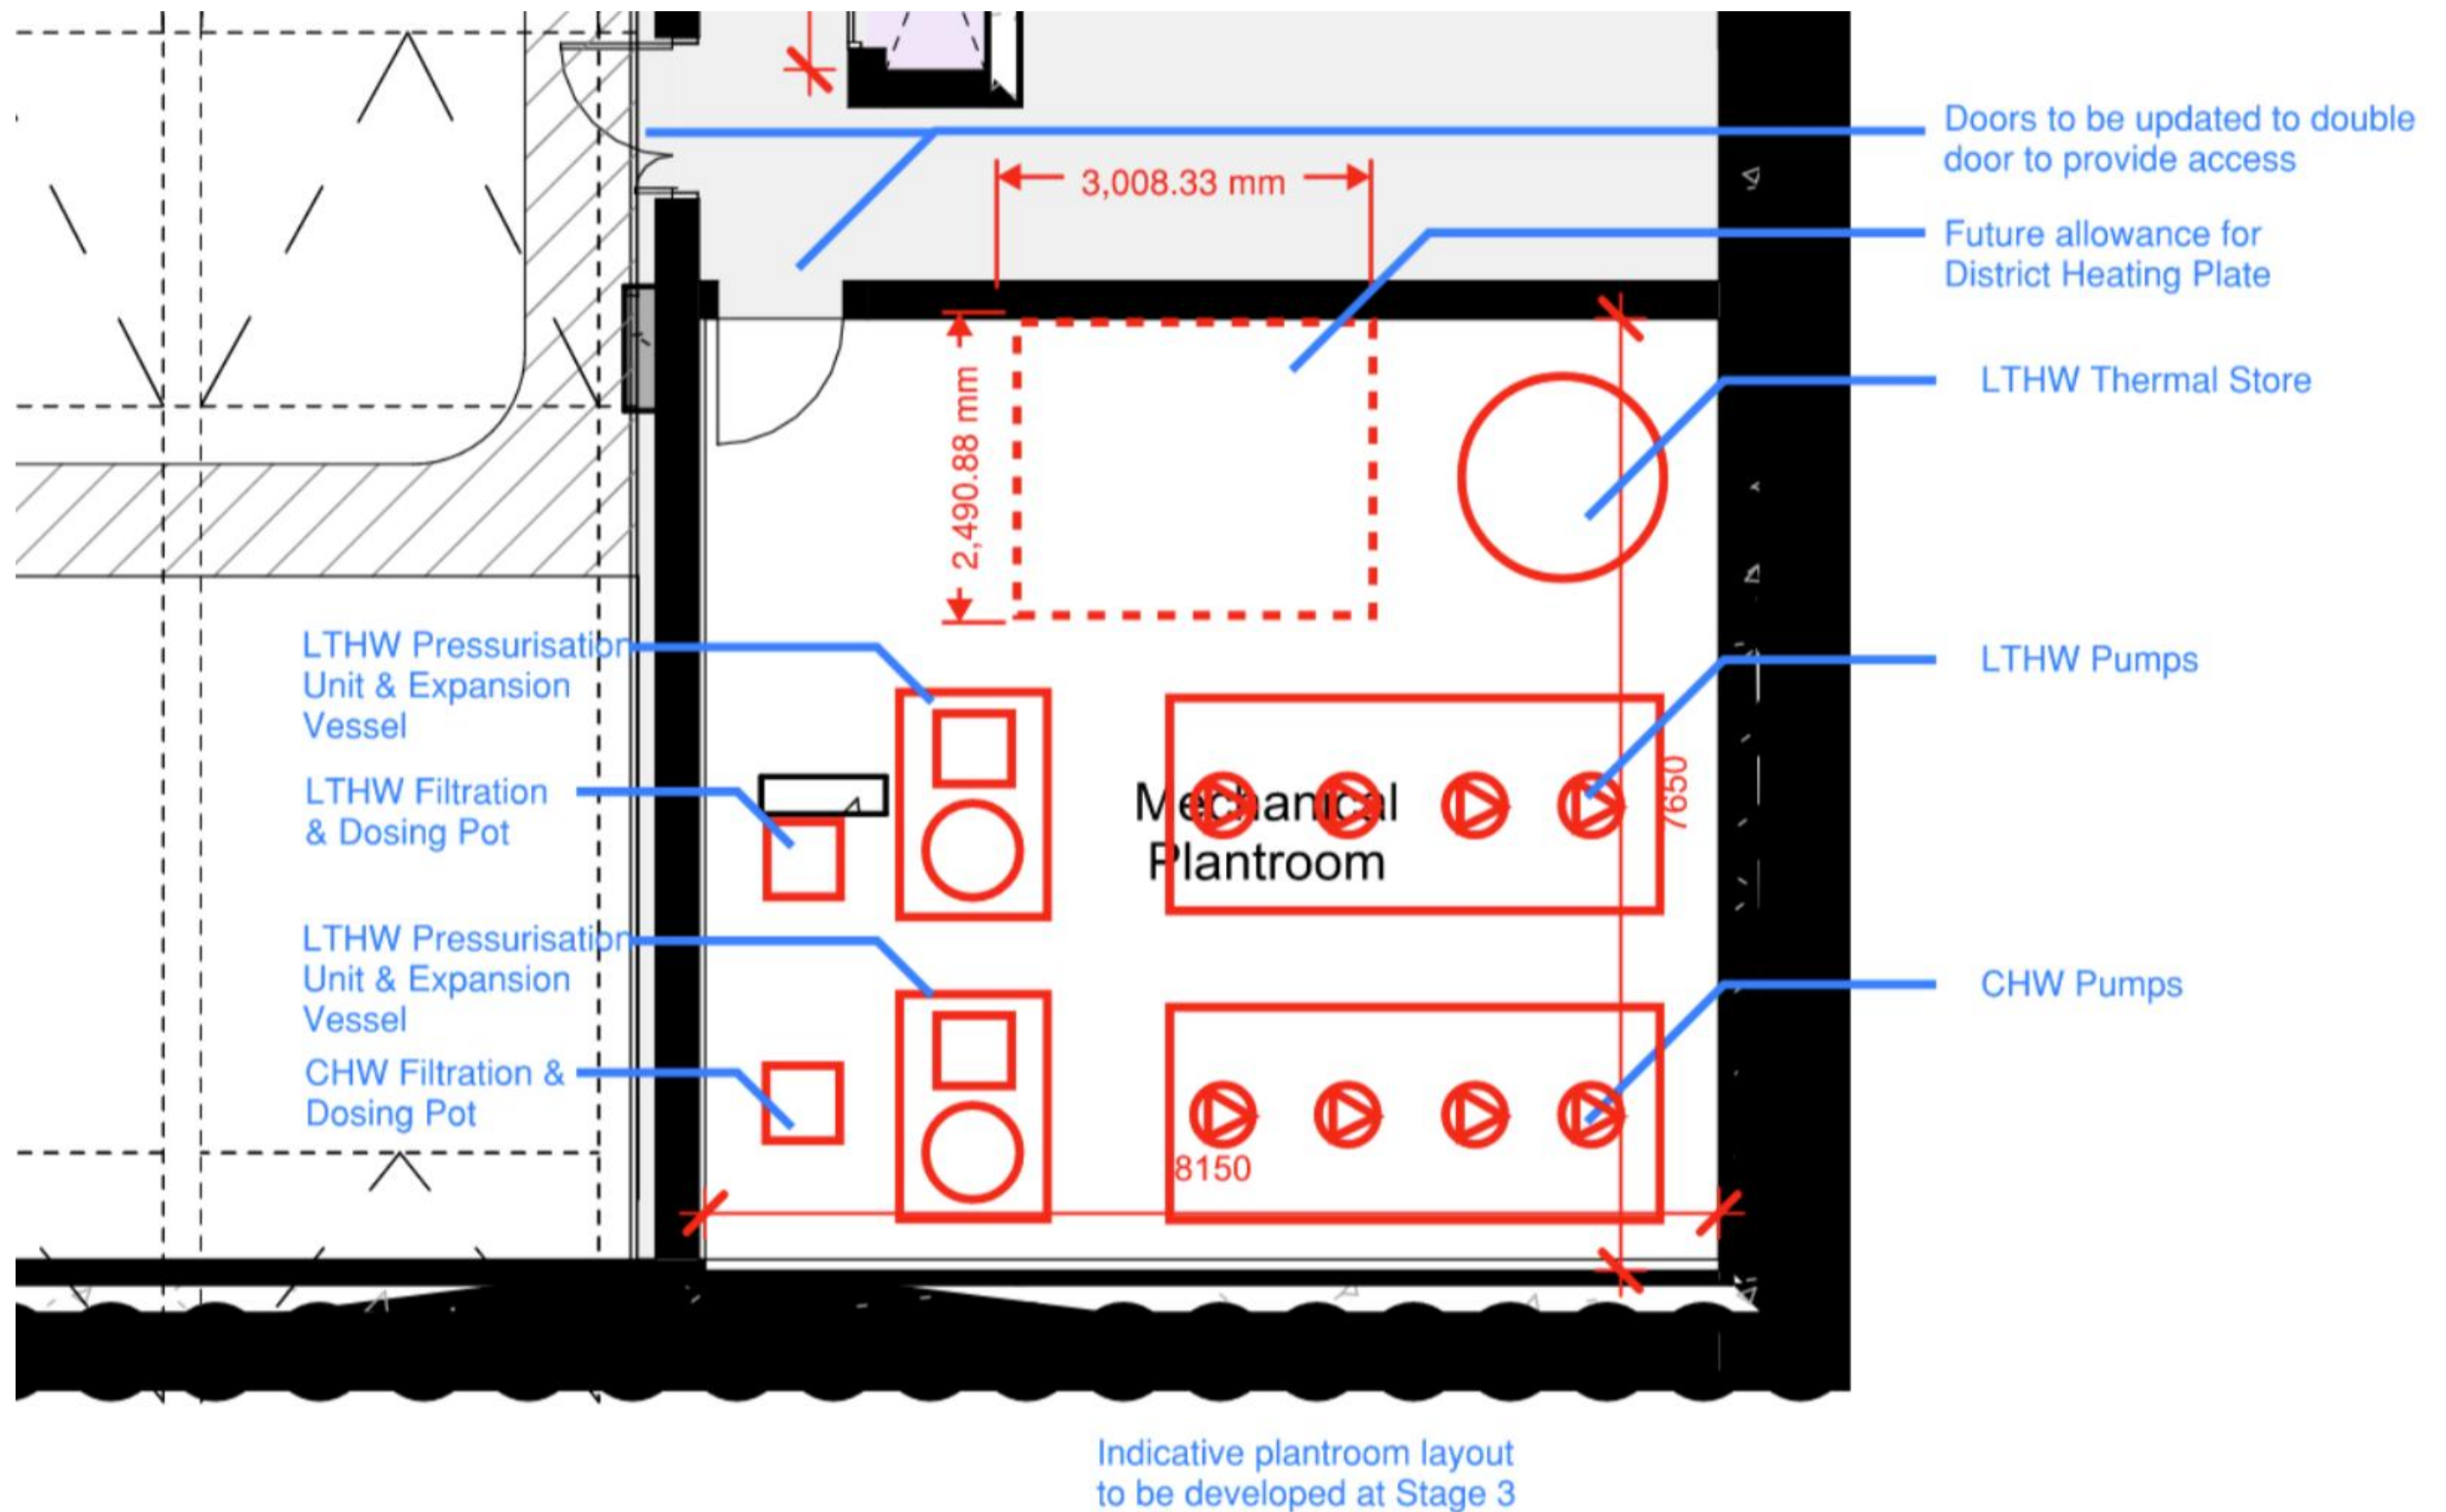

APPENDIX M Stage 2 MVHR Selections



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Technical Data

MRXBOX-ECO - Wall Mounted Multi Room Xbox

Fan Code: **MRXBOXAB-ECO2**

Installation Manual Links: 671795

Required duty: 40 l/s at 100 Pa

Actual duty: 63 l/s at 250 Pa

Actual at required flow: 40 l/s at 457 Pa

When speed controlled to required duty (63.05%):

Motor Input Power: 0.039 kW

At full speed:

Motor Input Power: 0.155 kW

Maximum Fan Speed: 3,750 RPM

Electrical Supply: 230V, 1 Phase, 50 Hz

Motor current (flc): 1.2 A

Max. operating temp: 40°C

Weight: 20 kg

Starting currents are nominal.

Sound Data

Acoustic performance to ISO 13347 and AMCA 300.

Noise calculated speed controlled to required duty (63.05%)


Sound Power Levels re 1 pWatts (Hz):

Hz	63	125	250	500	1k	2k	4k	8k	dBA
Breakout	48	53	49	47	39	35	23	<16	29
Open Inlet (Intake & Extract)	41	41	53	45	40	36	23	<16	
Open Outlet (Supply & Exhaust)	53	60	58	61	55	53	43	33	

dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.

Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

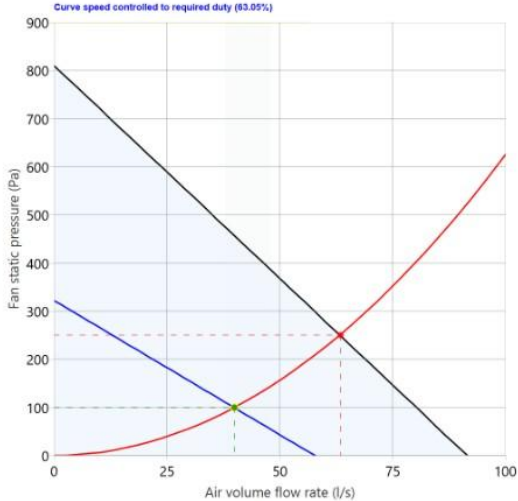

Specification

The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.

The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.

The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.

The unit shall be suitable for 125mm circular ducting.

The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.


The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Fan Dimensions

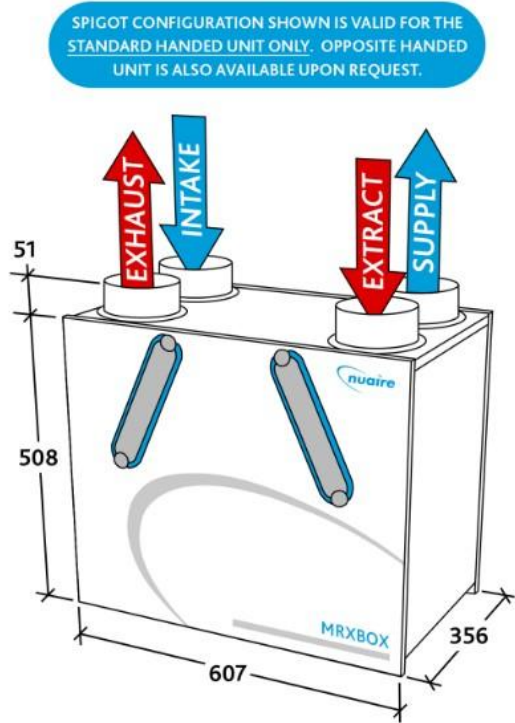

Length: Width: Height:
356 607 507
Spigot size: 125
Duct size: 125
Drawing is for dimensional purposes only. Dimensions in mm.
Please see selected ancillaries section for additional dimensions for any requested additional ancillaries.

SAP Appendix Q Test Results

Application	Specific Fan Power (W/l/s)	Heat Exchange Efficiency %
Kitchen + 1 wet room	0.52	90%
Kitchen + 2 wet rooms	0.59	89%
Kitchen + 3 wet rooms	0.77	87%
Kitchen + 4 wet rooms	1.0	86%
Kitchen + 5 wet rooms	1.23	86%



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Technical Data


MRXBOX-ECO - Wall Mounted Multi Room Xbox
Fan Code: **MRXBOXAB-ECO2**
Installation Manual Links: 671795
Required duty: 60 l/s at 100 Pa
Actual duty: 74 l/s at 152 Pa
Actual at required flow: 60 l/s at 279 Pa
When speed controlled to required duty (80.9%):
Motor Input Power: 0.082 kW

At full speed:
Motor Input Power: 0.155 kW
Maximum Fan Speed: 3,750 RPM
Electrical Supply: 230V, 1 Phase, 50 Hz
Motor current (flc): 1.2 A
Max. operating temp: 40°C
Weight: 20 kg
Starting currents are nominal.

Sound Data

Acoustic performance to ISO 13347 and AMCA 300.
Noise calculated speed controlled to required duty (80.9%)
Sound Power Levels re 1 pWatts (Hz):
Hz 63 125 250 500 1k 2k 4k 8k dBA
Breakout 53 56 52 50 42 39 27 <16 32
Open Inlet (Intake & Extract) 43 45 56 48 43 39 28 17
Open Outlet (Supply & Exhaust) 55 62 61 64 59 57 47 38
dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.
Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

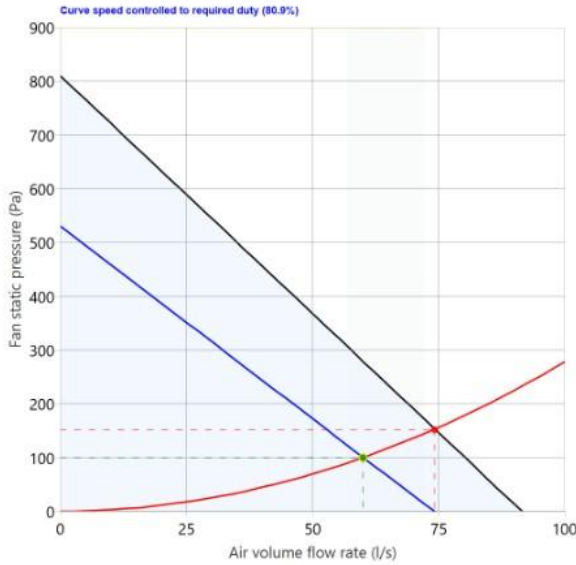

Specification


The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.
The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.
The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.
The unit shall be suitable for 125mm circular ducting.
The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.
The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Fan Dimensions

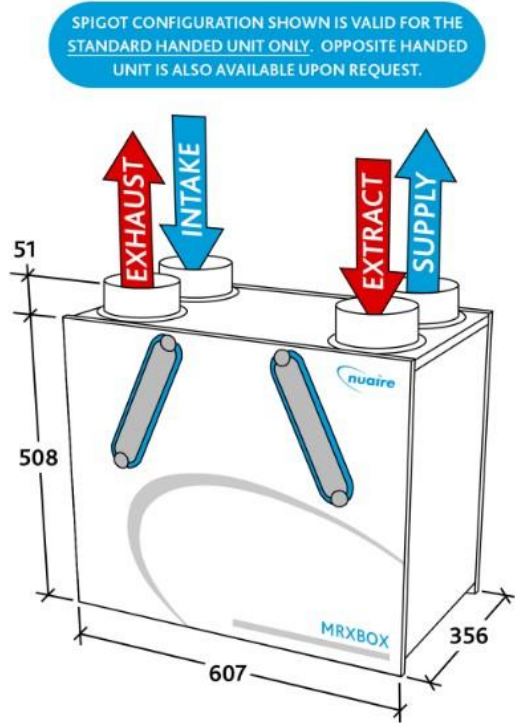

Length: Width: Height:
356 607 507
Spigot size: 125
Duct size: 125
Drawing is for dimensional purposes only. Dimensions in mm.
Please see selected ancillaries section for additional dimensions for any requested additional ancillaries.

SAP Appendix Q Test Results

Application	Specific Fan Power (W/l/s)	Heat Exchange Efficiency %
Kitchen + 1 wet room	0.52	90%
Kitchen + 2 wet rooms	0.59	89%
Kitchen + 3 wet rooms	0.77	87%
Kitchen + 4 wet rooms	1.0	86%
Kitchen + 5 wet rooms	1.23	86%



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Technical Data

MRXBOX-ECO - Wall Mounted Multi Room Xbox
Fan Code: MRXBOXAB-ECO2
Installation Manual Links: 671795

Required duty: 70 l/s at 100 Pa
Actual duty: 78 l/s at 123 Pa
Actual at required flow: 70 l/s at 191 Pa

When speed controlled to required duty (90.05%):
Motor Input Power: 0.114 kW

At full speed:
Motor Input Power: 0.156 kW

Maximum Fan Speed: 3,750 RPM
Electrical Supply: 230V, 1 Phase, 50 Hz
Motor current (flc): 1.2 A

Max. operating temp: 40°C
Weight: 20 kg
Starting currents are nominal.

Sound Data


Acoustic performance to ISO 13347 and AMCA 300.
Noise calculated speed controlled to required duty (90.05%)

Sound Power Levels re 1 pWatts (Hz):									
Hz	63	125	250	500	1k	2k	4k	8k	dBA
Breakout	55	57	52	51	43	40	28	17	33
Open Inlet (Intake & Extract)	44	46	57	49	45	40	29	20	
Open Outlet (Supply & Exhaust)	55	63	62	65	60	59	48	40	

dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.

Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

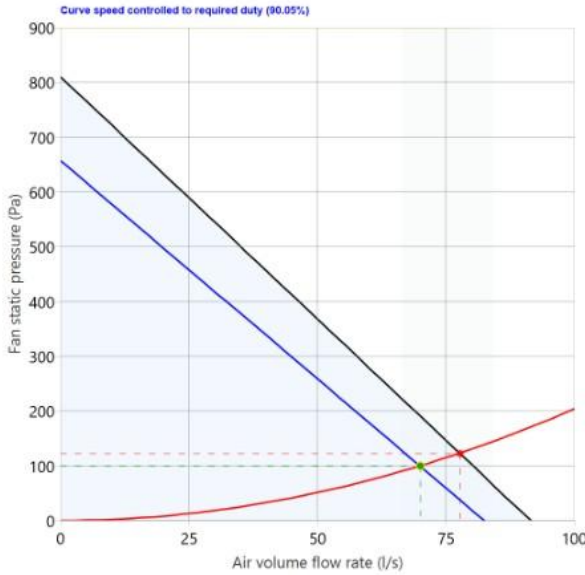


Specification

The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.
The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.
The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.
The unit shall be suitable for 125mm circular ducting.
The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.
The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.

nuaire SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:37 using software version 5.8.4590.0

Fan Dimensions

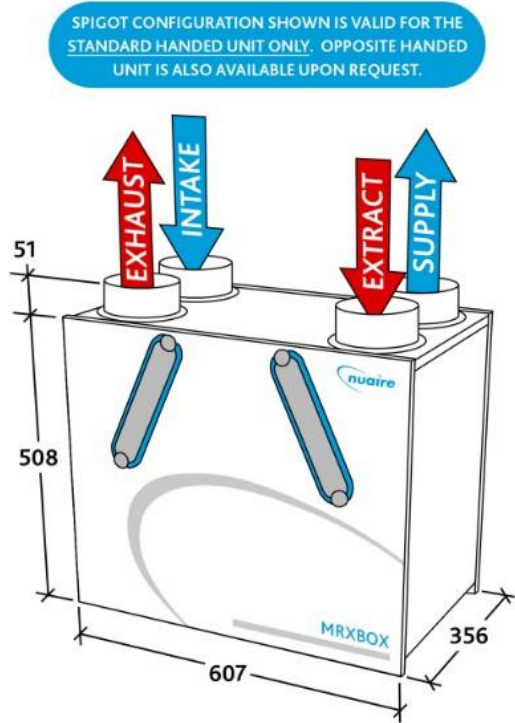

Length: 607mm
Width: 356mm
Height: 508mm
Spigot size: 125mm
Duct size: 125mm
Drawing is for dimensional purposes only. Dimensions in mm.
Please see selected ancillaries section for additional dimensions for any requested additional ancillaries.

SAP Appendix Q Test Results

Application	Specific Fan Power (W/l/s)	Heat Exchange Efficiency %
Kitchen + 1 wet room	0.52	90%
Kitchen + 2 wet rooms	0.59	89%
Kitchen + 3 wet rooms	0.77	87%
Kitchen + 4 wet rooms	1.0	86%
Kitchen + 5 wet rooms	1.23	86%

nuaire SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:38 using software version 5.8.4590.0

Technical Data


MRXBOX-ECO - Wall Mounted Multi Room Xbox
Fan Code: **MRXBOXAB-ECO2**
Installation Manual Links: 671795
Required duty: 75 l/s at 100 Pa
Actual duty: 79 l/s at 111 Pa
Actual at required flow: 75 l/s at 146 Pa
When speed controlled to required duty (94.74%):
Motor Input Power: 0.132 kW

At full speed:
Motor Input Power: 0.156 kW
Maximum Fan Speed: 3,750 RPM
Electrical Supply: 230V, 1 Phase, 50 Hz
Motor current (flc): 1.2 A
Max. operating temp: 40°C
Weight: 20 kg
Starting currents are nominal.

Sound Data

Acoustic performance to ISO 13347 and AMCA 300.
Noise calculated speed controlled to required duty (94.74%)
Sound Power Levels re 1 pWatts (Hz):
Hz 63 125 250 500 1k 2k 4k 8k dBA
Breakout 57 57 53 52 44 41 29 18 34
Open Inlet (Intake & Extract) 45 47 57 51 45 41 30 22
Open Outlet (Supply & Exhaust) 55 63 63 66 61 60 49 41
dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.
Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

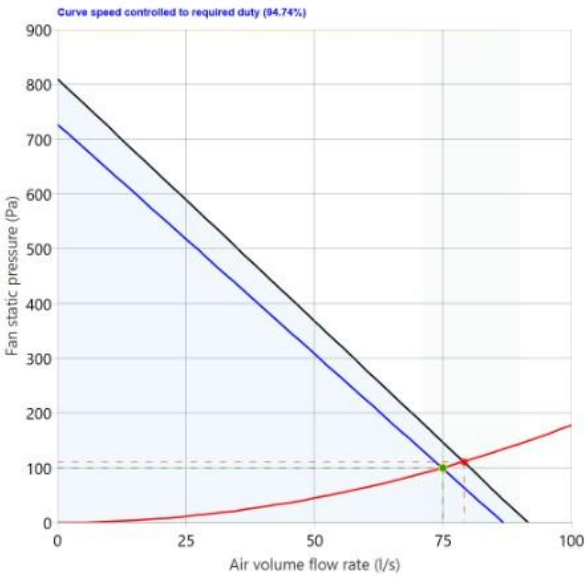

Specification


The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.
The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.
The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.
The unit shall be suitable for 125mm circular ducting.
The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.
The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:38 using software version 5.8.4590.0

Fan Dimensions

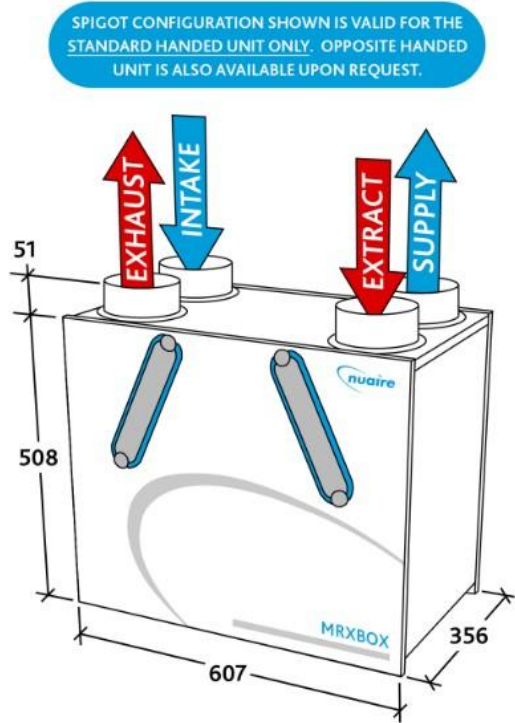

Length: Width: Height:
356 607 507
Spigot size: 125
Duct size: 125
Drawing is for dimensional purposes only. Dimensions in mm.
Please see selected ancillaries section for additional dimensions for any requested additional ancillaries.

SAP Appendix Q Test Results

Application	Specific Fan Power (W/l/s)	Heat Exchange Efficiency %
Kitchen + 1 wet room	0.52	90%
Kitchen + 2 wet rooms	0.59	89%
Kitchen + 3 wet rooms	0.77	87%
Kitchen + 4 wet rooms	1.0	86%
Kitchen + 5 wet rooms	1.23	86%



SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:38 using software version 5.8.4590.0

Technical Data

MRXBOX-ECO - Wall Mounted Multi Room Xbox
Fan Code: MRXBOXAB-ECO3
Installation Manual Links: 671796

Required duty: 85 l/s at 100 Pa
Actual duty: 90 l/s at 113 Pa
Actual at required flow: 85 l/s at 149 Pa

When speed controlled to required duty (94.07%):
Motor Input Power: 0.13 kW

At full speed:
Motor Input Power: 0.157 kW

Maximum Fan Speed: 3,750 RPM
Electrical Supply: 230V, 1 Phase, 50 Hz
Motor current (flc): 1.2 A
Max. operating temp: 40°C
Weight: 24 kg
Starting currents are nominal.

Sound Data


Acoustic performance to ISO 13347 and AMCA 300.
Noise calculated speed controlled to required duty (94.07%)

Sound Power Levels re 1 pWatts (Hz):	63	125	250	500	1k	2k	4k	8k	dBA
Breakout	55	55	53	52	45	43	29	<16	34
Open Inlet (Intake & Extract)	44	52	57	49	47	41	31	20	
Open Outlet (Supply & Exhaust)	54	62	60	63	59	59	49	41	

dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.

Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

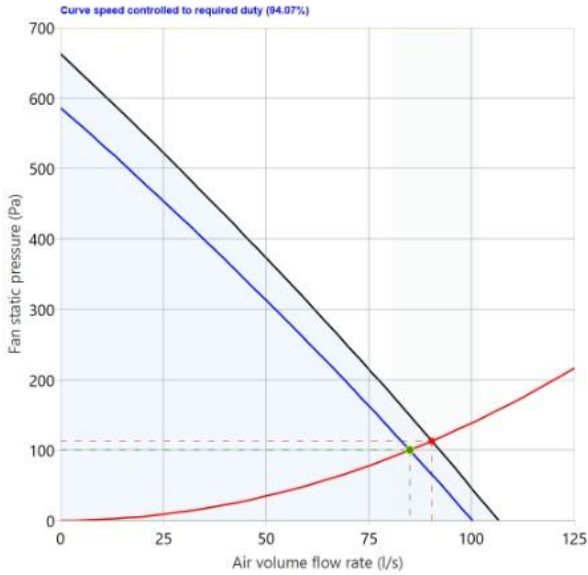


Specification

The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.
The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.
The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.
The unit shall be suitable for 150mm circular ducting.
The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.
The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.

nuaire SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:38 using software version 5.8.4590.0

Fan Dimensions

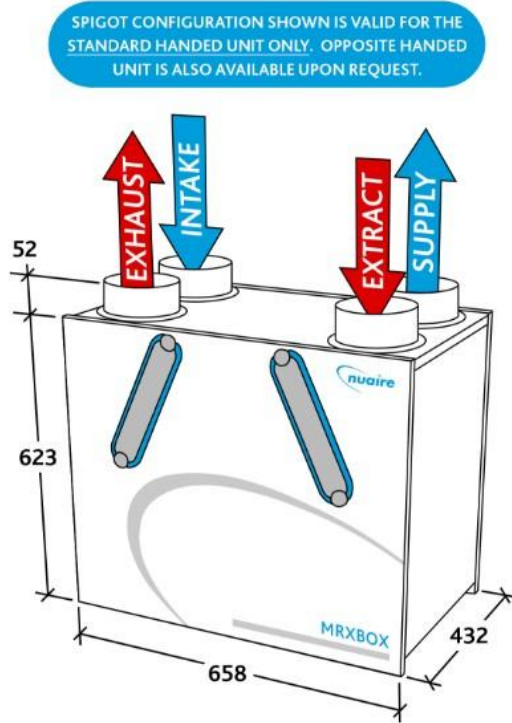

Length: Width: Height:
432 658 623
Spigot size: 150
Duct size: 150
Drawing is for dimensional purposes only. Dimensions in mm.
Please see selected ancillaries section for additional dimensions for any requested additional ancillaries.

SAP Appendix Q Test Results

Application	Specific Fan Power (W/l/s)	Heat Exchange Efficiency %
Kitchen + 1 wet room	0.5	90%
Kitchen + 2 wet rooms	0.53	90%
Kitchen + 3 wet rooms	0.6	89%
Kitchen + 4 wet rooms	0.75	88%
Kitchen + 5 wet rooms	0.92	88%
Kitchen + 6 wet rooms	1.1	87%
Kitchen + 7 wet rooms	1.36	87%

nuaire SUMMARY FAN DATA SHEET

Nuaire, Western Industrial Estate, Caerphilly, CF83 1NA, United Kingdom. email:info@nuaire.co.uk
UK Commercial enquiries T:029 2085 8200 UK Residential enquiries T:029 2085 8500 International enquiries T:+44.29 2085 8497
Whilst the information given on this data sheet is fan specific, it is in summary and reference to the product selection catalogue and installation & maintenance documents is recommended.
This data sheet produced on 14 Mar 2025 15:39 using software version 5.8.4590.0

Technical Data


MRXBOX-ECO - Wall Mounted Multi Room Xbox
Fan Code: **MRXBOXAB-ECO3**
Installation Manual Links: 671796
Required duty: 90 l/s at 100 Pa
Actual duty: 92 l/s at 104 Pa
Actual at required flow: 90 l/s at 115 Pa
When speed controlled to required duty (98.25%):
Motor Input Power: 0.149 kW

At full speed:
Motor Input Power: 0.157 kW
Maximum Fan Speed: 3,750 RPM
Electrical Supply: 230V, 1 Phase, 50 Hz
Motor current (flc): 1.2 A
Max. operating temp: 40°C
Weight: 24 kg
Starting currents are nominal.

Sound Data

Acoustic performance to ISO 13347 and AMCA 300.
Noise calculated speed controlled to required duty (98.25%)
Sound Power Levels re 1 pWatts (Hz):
Hz 63 125 250 500 1k 2k 4k 8k dBA
Breakout 56 56 54 52 45 43 30 <16 35
Open Inlet (Intake & Extract) 44 52 57 49 47 42 31 20
Open Outlet (Supply & Exhaust) 55 63 60 63 59 59 50 42
dBA is hemi-spherical at 3 metres. For spherical deduct 3 dBA.
Please note that the noise data stated on this data sheet for the unit and/or silencer is tested in accordance with UK, European and International industry laboratory standards. However onsite conditions may vary and we would recommend that this information is verified by an acoustic specialist in order to ensure its suitability for the intended application.

Performance Chart

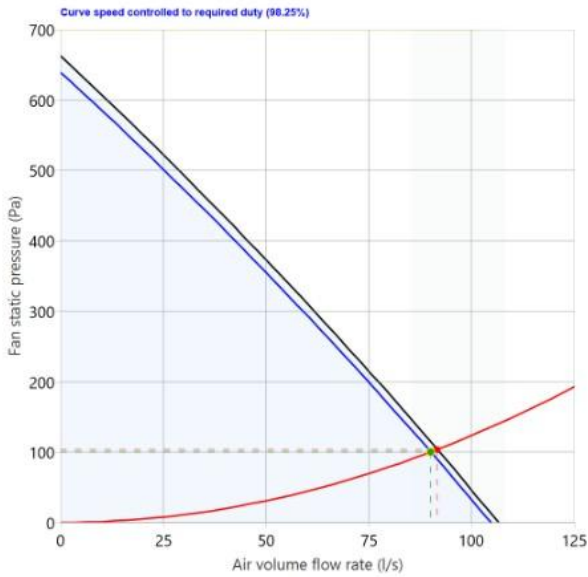

Specification

The unit shall be fully insulated providing excellent thermal and acoustic characteristics and shall be complete with a multi plate counter flow high efficiency heat exchanger block, with a thermal efficiency of up to 95%. The heat exchanger shall be protected by filters on fresh air inlet and system extract. The heat exchanger and filters shall be accessible via the front access panel, enabling quick and easy maintenance.
The unit shall have low energy, high efficiency EC fan/motor assemblies with sealed for life bearings, the impellers shall be backward curved centrifugal type. The motors shall be suitable for an ambient temperature of 40°C.
The unit shall be supplied complete with a condensate drip tray and 21.5mm drain connection.
The unit shall be suitable for 150mm circular ducting.
The breakout noise level and power requirements shall be as detailed by the unit manufacturer and in accordance with the ventilation equipment schedule.
The unit shall be offered with a five year warranty. The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuaire International Sales office for further details.